

EXHIBIT 1¹

**Equipment List
Hanging Hardware**

Component	Manufacturer / Model
Nozzle	VST Model VST-EVR-NB, VST-EVR-NB (Rebuilt) Or VST Model VST-EVR-NB (G2), VST-EVR-NB (G2 Rebuilt) Or EMCO Models A4005EVR, RA4005EVR (Rebuilt) (Figure 1A-1)
Coaxial Curb Hose²	VST Model VDV-EVR Series Or VDVP-EVR Series Or ContiTech Model Maxxim Premier Plus (532-365-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location (“NV” stamped on nozzle end) Or ContiTech Model Maxxim Premier Ultra (532-366-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location (“NV” stamped on nozzle end) (Figure 1A-2)
Coaxial Whip Hose	VST Model VSTA-EVR Series Or VSTAP-EVR Series Or ContiTech Model Maxxim Premier Plus (532-365-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location Or ContiTech Model Maxxim Premier Ultra (532-366-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location (Figure 1A-2)
Breakaway Coupling	VST Model VSTA-EVR-SBK, VSTA-EVR-SBK (Reattachable) ³ Or EMCO Models A4119EVR-X X = 020 or 020S (Factory Serviced) Or EMCO Models A4119EVR-X (Reconnectable) X = 020RC or 020RCS (Factory Serviced) Or OPW Model 66CLP (Figure 1A-2)

¹ The local air district may require a permit application when changing between alternate components.

² Veyance brand name has changed to ContiTech.

³ The lower half of the VST reattachable breakaway, identified with a VST logo, cannot be used on the VST non-reattachable or rebuilt breakaways.

Allowable Hanging Hardware Combinations Including ISD Systems

Processor	Nozzle		Hose		Breakaway			ISD	
	VST	EMCO	VST	ContiTech	VST	EMCO	OPW	Veeder-Root	INCON
VST Membrane	●		●	●	●	●	●	●	
Veeder Root Vapor Polisher	●	●	●	●	●	●	●	●	
FFS Clean Air Separator	●	● ⁴	●	●	●	●	●	●	● ⁴
Hirt VCS 100	● ⁵	●	●	●	●	●	●	●	● ⁵
VST Green Machine	●		●	●	●	●	●	●	

⁴ EMCO Nozzle for use with FFS Clean Air Separator is not allowed with INCON ISD System.

⁵ VST Nozzle for use with Hirt VCS-100 is not allowed with INCON ISD System.

ONLY ONE OF THE FOLLOWING FIVE (5) PROCESSOR GROUPS IS REQUIRED

**VST Membrane
Processor Equipment List #1**

Component	Manufacturer / Model
Veeder-Root TLS-350 Series, including but not limited to TLS-350, TLS-350 Plus, TLS-350R, Red Jacket ProMax, Gilbarco EMC consoles (TLS Console)	Veeder-Root 8482XX-XXX, 8470XX-XXX, ProMax 847097-XXX EMC PAO2620X000X X = Any digit (Figure 1A-3A)
RS232 Interface Module	Veeder-Root RS232 Interface Module Series (Figure 1A-3B)
VST Membrane Processor	VST Model VST-ECS-CS3-XXX (Figure 1A-4) where XXX represents motor phase and HC Sensor 110 =Single-Phase with HC Sensor 310=Three-Phase with HC Sensor
Pressure Management Control (PMC) Software Version Number	1.04
Vapor Pressure Sensor ¹ (1 per GDF)	Veeder-Root 331946-001 or 861190-201 – Wired, approved for installation in the dispenser or on the vent stack (Figure 1A-5) or Veeder Root 861190-201 - Low Powered Wireless, approved for installation on the vent stack only (Figure 1A-5)
Vapor Pressure Sensor Desiccant Tube - Optional (1 per GDF)	Veeder-Root 330020-717 – Dryer Tube (Figure 1A-5)
Multiport Card	Veeder-Root 330586-018
Universal Enclosure Kit ²	Veeder-Root 330020-716 (Figure 1A-9)

¹ Wireless sensors require additional components specified in Veeder-Root Optional Wireless Component Equipment List.

² Required for vapor pressure sensors installed on the vent line (wired or wireless).

**Veeder-Root Vapor Polisher
Processor Equipment List #2**

Component	Manufacturer / Model
Veeder-Root TLS-350 Series, including but not limited to TLS-350, TLS-350 Plus, TLS-350R, Red Jacket ProMax, Gilbarco EMC consoles (TLS Console)	Veeder-Root 8482XX-XXX, 8470XX-XXX, Promax 847097-XXX EMC PAO2620X000X X = Any digit (Figure 1A-3A)
RS232 Interface Module	Veeder-Root RS232 Interface Module Series (Figure 1A-3B)
Veeder-Root Vapor Polisher ¹	Veeder Root Vapor Polisher 332761-002 (Figure 1A-6) - Wired or Wireless
PMC Software Version Number	1.04
Vapor Pressure Sensor ¹ (1 per GDF)	Veeder-Root 331946-001 or 861190-201 – Wired, approved for installation in the dispenser or on the vent stack (Figure 1A-5) or Veeder Root 861190-201 - Low Powered Wireless, approved for installation on the vent stack only (Figure 1A-5)
Vapor Pressure Sensor Desiccant Tube - Optional (1 per GDF)	Veeder-Root 330020-717 – Dryer Tube (Figure 1A-5)
Smart Sensor Interface Module (1 per GDF) With Atmospheric Sensor	Veeder-Root 329356-004 (Figure 1A-7) Veeder-Root 332250-001
Universal Enclosure Kit ²	Veeder-Root 330020-716 (Figure 1A-9)

¹ Wireless sensors require additional components specified in Veeder-Root Optional Wireless Component Equipment List.

² Required for the vapor valve wireless battery/transmitter and vapor pressure sensors installed on the vent line (wired or wireless).

**Franklin Fueling Systems - Healy Clean Air Separator
Processor Equipment List #3**

Component	Manufacturer / Model
Franklin Fueling Systems Clean Air Separator	Healy Model 9961 Clean Air Separator (Figures 1A-10 and 1A-11) Healy Model 9961H Clean Air Separator (Figures 1A-12 and 1A-13)

**Hirt VCS 100
Processor Equipment List #4**

Component	Manufacturer / Model
Hirt Thermal Oxidizer With Indicator Panel	Hirt Model VCS 100 (Figure 1A-15) Leg Attachments: 5" – M39 48"- M40
Hirt 1/4" Check Valve (optional component)	Hirt P65

**VST Green Machine
Processor Equipment List #5**

Component	Manufacturer / Model
Veeder-Root TLS-350 Series, including but not limited to TLS-350, TLS-350 Plus, TLS-350R, Red Jacket ProMax, Gilbarco EMC consoles (TLS Console)	Veeder-Root 8482XX-XXX, 8470XX-XXX, Promax 847097-XXX EMC PAO2620X000X X = Any digit (Figure 1A-3A)
RS232 Interface Module	Veeder-Root RS232 Interface Module Series (Figure 1A-3B)
Green Machine Processor, including controller	VST Model VST-GM-CS1-100 (Figure 1A-22)
Pressure Management Control (PMC) Software Version Number	1.04
Vapor Pressure Sensor¹ (1 per GDF)	Veeder-Root 331946-001 or 861190-201 – Wired, approved for installation in the dispenser or on the vent stack (Figure 1A-5) or Veeder Root 861190-201 - Low Powered Wireless, approved for installation on the vent stack only (Figure 1A-5)
Vapor Pressure Sensor Desiccant Tube - Optional (1 per GDF)	Veeder-Root 330020-717 – Dryer Tube (Figure 1A-5)
Multiport Card	Veeder-Root 330586-018
Universal Enclosure Kit²	Veeder-Root 330020-716 (Figure 1A-9)

¹ Wireless sensors require additional components specified in Veeder-Root Optional Wireless Component Equipment List.

² Required for vapor pressure sensors installed on the vent line (wired or wireless).

**Liquid Condensate Trap
Equipment List**

Component	Manufacturer / Model
Riser Adapter	INCON model TSP-K2A (Figure 1A-14)
In-Line Filter	140 micron, Swagelok B-4F2-140 or SS-4F2-140, or equivalent (Figure 1A-14)
Screen	Aluminum Insect screen (18X14 mesh), or Stainless Steel Insect screen (18X18 mesh). (Figure 1A-14)
Stainless Steel Hose Clamp	Sized to secure screen to suction tube. (Figure 1A-14)
Liquid Sensor¹	Must have an audible and visual alarm (Figure 1A-14)
Liquid Condensate Trap¹	Any capacity, manufacturer, make and model (Figure 1A-14)

¹ Must meet applicable State Water Resources Control Board requirements (e.g. LG 113, LG 167 and LG 169) and any local authority having jurisdiction which includes the Certified Unified Program Agency (CUPA).

ONLY ONE OF THE FOLLOWING TWO (2) ISD SYSTEM GROUPS IS REQUIRED

**Veeder-Root ISD System
Equipment List #1**

Component	Manufacturer / Model
Veeder-Root TLS-350 Series, including but not limited to TLS-350, TLS-350 Plus, TLS-350R, Red Jacket ProMax, Gilbarco EMC consoles (TLS Console)	Veeder-Root 8482XX-XXX, 8470XX-XXX, Promax 847097-XXX EMC PAO2620X000X X = Any digit (Figure 1A-3A)
Balance Low Pressure Drop Vapor Flow Meter ¹ (1 per Dispenser)	Veeder-Root 332374-XXX - Wired or Wireless (Figure 1A-8) X = Any digit
Vapor Pressure Sensor ¹ (1 per GDF)	Veeder-Root 331946-001 or 861190-201 – Wired, approved for installation in the dispenser or on the vent stack (Figure 1A-5) or Veeder Root 861190-201 - Low Powered Wireless, approved for installation on the vent stack only (Figure 1A-5)
Vapor Pressure Sensor Desiccant Tube - Optional (1 per GDF)	Veeder-Root 330020-717 – Dryer Tube (Figure 1A-5)
Smart Sensor Interface Module (1 per GDF)	Veeder Root 329356-004, 332250-001 (Figure 1A-7)
RS232 Interface Module	Veeder-Root RS232 Interface Module Series (Figure 1A-3B)
ISD Software Version Number²	Veeder-Root 1.05
Universal Enclosure Kit ³	Veeder-Root 330020-716 (Figure 1A-9)
Dispenser Interface Module	Veeder-Root DIM Series

¹ Wireless sensors require additional components specified in Veeder-Root Optional Wireless Component Equipment List.

² For new installations ISD software version 1.05 is compatible with all processors listed in this EO. For existing installations, refer to the Veeder-Root ISD software version compatibility matrix listed in this Exhibit.

³ Only required for vapor pressure sensors installed on the vent line.

**Veeder-Root
Optional Wireless Component Equipment List**

Component	Manufacturer / Model
TLS RF Console-2 Box (1 per GDF)	Veeder-Root 332242-002 (Figure 1A-9)
RF Transmitter-2¹ (1 per Veeder-Root Sensor including Vapor Pressure Sensor, Low Pressure Drop Vapor Flow Meter, and Vapor Polisher Processor)	Veeder-Root 332235-016 (Figure 1A-9)
RF Transmitter Battery Pack¹ (1 per Transmitter)	Veeder-Root 332425-011 (Figure 1A-9)
RF Repeater-2 (1 per GDF)	Veeder-Root 332440-030 (Figure 1A-9)
RF Receiver-2 (1 per GDF)	Veeder-Root 332440-029 (Figure 1A-9)

¹The RF Transmitter-2 and the RF Transmitter Battery Pack for the wireless vapor valve and wireless pressure sensor must be installed in the Universal Enclosure Kit.

**Veeder-Root
Optional Maintenance Tracker Security Feature**

Component	Manufacturer/Model
Maintenance Tracker Kit	Veeder-Root 330020-546 Consists of the following components: <ul style="list-style-type: none">• Technician Key (Figure 1A-16)• Interface Module RS232/485 Dual Module with DB9 Converter or Single Port Module with DB 25 converter (Figure 1A-17)• Manual

**INCON ISD System
Equipment List #2**

Component	Manufacturer/Model
ISD Console TS-EMS TS-550 TS-5000	INCON / TEMSXXXX/YV INCON / T550XXXX/YYYYV INCON / T5000XXXX/YYYYV Where: X represents hardware option (Example: X can be: 'D' for Display, 'P' for Printer) Y represents software option (Example: Y can be: 'S' for Secondary Containment Monitoring or T Tank Testing) V represents Vapor Recovery Monitoring Application (Figure 1A-18) Note: 1. All consoles come standard with RS-232 (COMM1) and Ethernet ports for data access.
ISD Vapor Recovery Monitoring (VRM) Software	INCON / TS-VRM Versions 1.3.0 and 1.3.1 with FFS CAS Processor INCON / TS-VRM Version 1.3.1 with Hirt VCS 100 Processor Note: INCON/TS-VRM software versions 1.3.0 and 1.3.1 are approved for and shall be used or installed only with uni-hose dispensers.
ISD Vapor Flow Meter (1 per Dispenser)	INCON TS-VFM (Figure 1A-19)
ISD Vapor Pressure Sensor (1 per GDF)	INCON TS-VPS (Figure 1A-20)
Data Transfer Unit (Optional) (1 per dispenser and 1 per GDF)	INCON TS-DTU / P (Figure 1A-21) Note: Optional installation method for the replacement of dedicated wires to VFM and VPS. Refer to the IOM for more information.
Dispenser Retrofit Kit (Optional) (1 per dispenser with DTU)	INCON TS-DRK/x Where X represents Type of Installation Kit W, Wayne Installation Kit E, Gilbarco Encore Installation Kit A, Gilbarco Advantage Installation Kit T, Tokheim Installation Kit

**Veeder-Root ISD
Software Version Compatibility Matrix**

Software Version*	Processor					Options			
	VST		Veeder- Root Vapor Polisher Standard Capacity	Veeder- Root Vapor Polisher Extended Capacity	Healy CAS	Hirt VCS 100	Dispenser Shutdown*** and Collection Monitoring Update	Wireless Components	Maintenance Tracker
	Membrane	Green Machine							
1.01	•				•				•
1.02	•		•		•				•
1.03	•		•		•		•		•
1.04	•			•	•		•	•	•
1.05**	•	•		•	•	•	•	•	•

*Software Version 1.01 has been revoked for GDF's equipped with multiproduct (six pack) dispensers with fuel blending. Subject GDFs must upgrade to higher version software (1.02, 1.03, 1.04, or 1.05) by 07/01/2012.

**For new installations ISD software version 1.05 is compatible with all processors listed in this EO. For existing installations, refer to the above software compatibility matrix.

With the exception of multiproduct (six pack) dispensers with fuel blending, software Versions 1.01, 1.02, 1.03, and 1.04 may remain in use at existing GDFs.

Software Version 1.05 must be installed at new GDFs or those undergoing a major modification as determined by date when the district issues the permit to construct.

***Dispenser shutdown can be achieved by alternate means for GDFs equipped with Software Version 1.01 and 1.02 as indicated in the ARB approved IOM for the Veeder-Root ISD System.

Figure 1A-1
VST Model VST-EVR- NB Nozzle

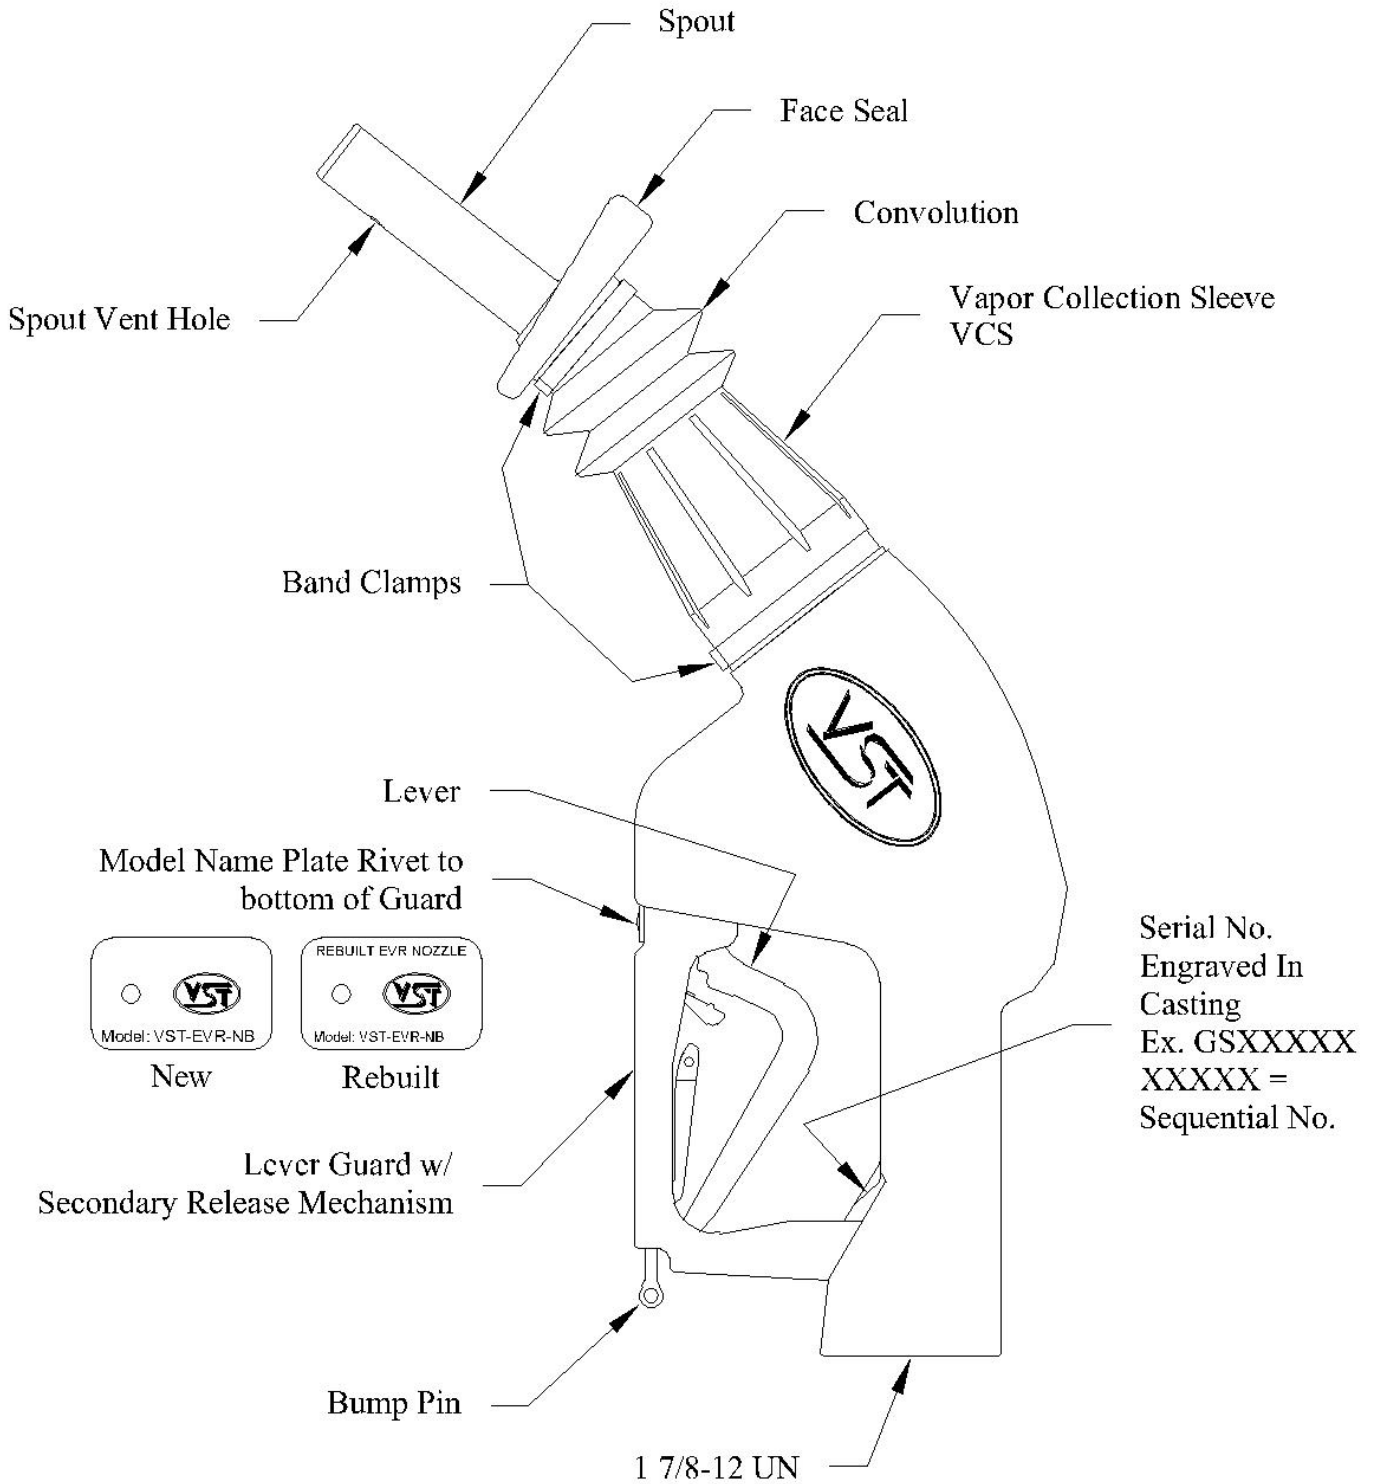


Figure 1A-1 (continued)
VST Model VST-EVR-NB (G2) Nozzle

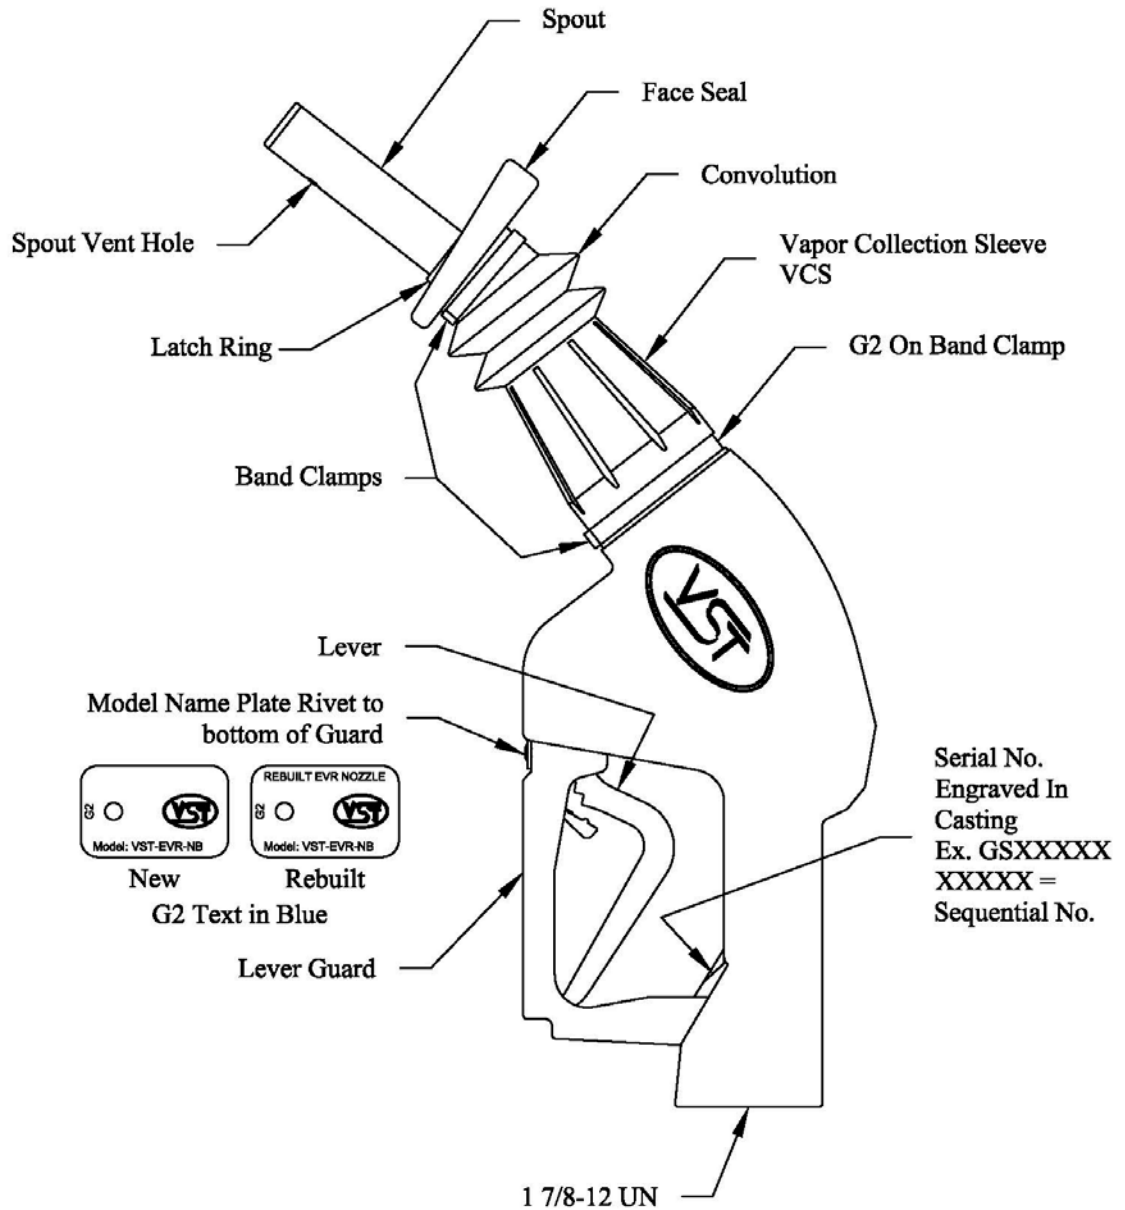


Figure 1A-1 (continued)
EMCO Model A4005EVR Nozzle


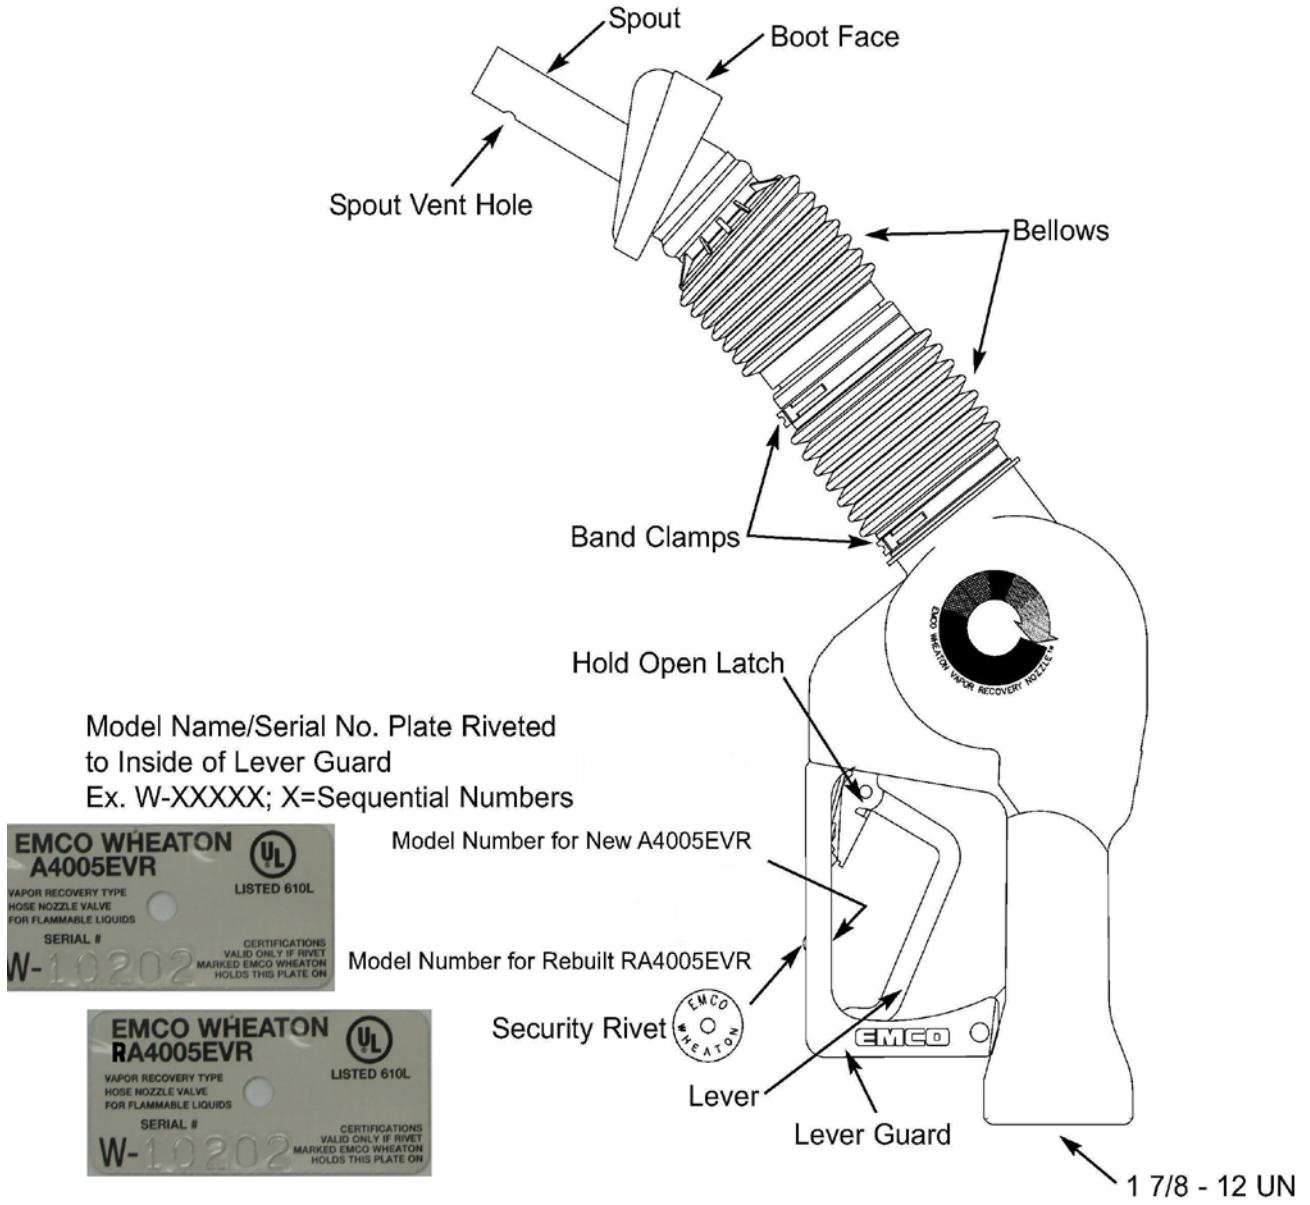


Figure 1A-2
Hanging Hardware
(Nozzle, Coaxial Curb Hose, Breakaway, and Coaxial Whip Hose)

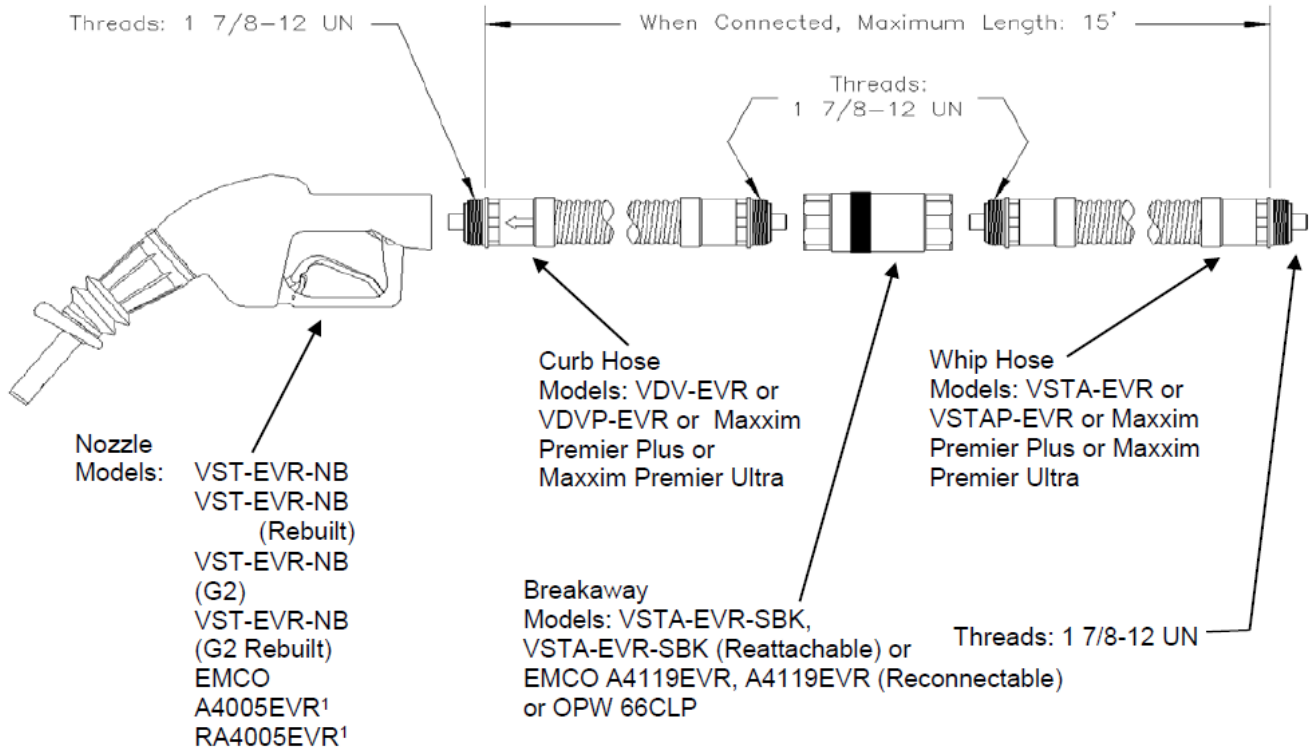

¹ Alternate component for use with the Veeder-Root Vapor Polisher or Hirt Thermal Oxidizer processors or Clean Air Separator

Figure 1A-2 (continued)
VST Hanging Hardware
(Nozzle)



Figure 1A-2 (continued)
VST Hanging Hardware
(Breakaway)



Figure 1A-2 (continued)
VST Hanging Hardware
(Coaxial Curb Hose and Coaxial Whip Hose)



Figure 1-A2 (Continued)
VST Hanging Hardware
(Coaxial Curb Hose and Coaxial Whip Hose)

Coaxial Curb Hose Model VDVP-EVR Series
Serial Number Location



Curb Hose Ferrule Sleeve Identification



Coaxial Whip Hose Model VSTAP-EVR Series

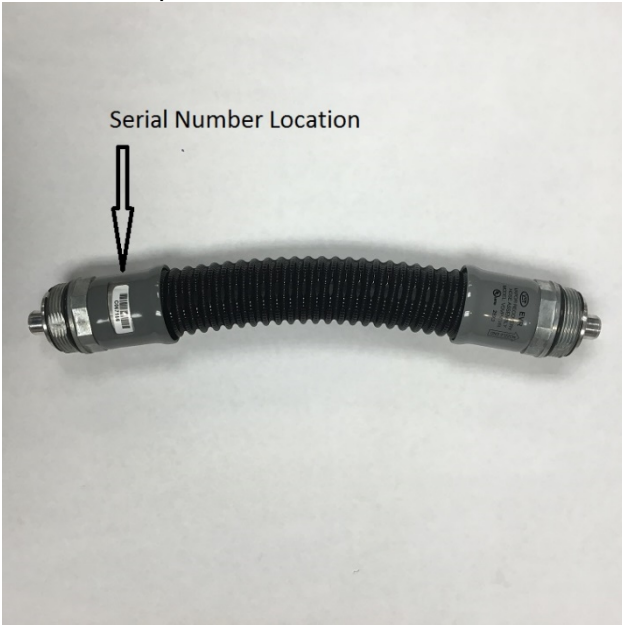


Figure 1A-2 (continue)
EMCO Hanging Hardware
(Nozzle and SafeBreak Valve)



Figure 1A-2 (continued)
OPW Hanging Hardware
(Breakaway)



Figure 1A-2 (continued)
ContiTech USA, Inc. Hanging Hardware
(Curb and Whip Hoses)



Serial Number Location



Coaxial Whip Hose: Maxim Premier Ultra



Coaxial Curb Hose: Maxim Premier Ultra



Serial Number Location



Figure 1A-3A
Veeder-Root TLS Console



Figure 1A-3B
Veeder-Root RS232 Interface Module Series


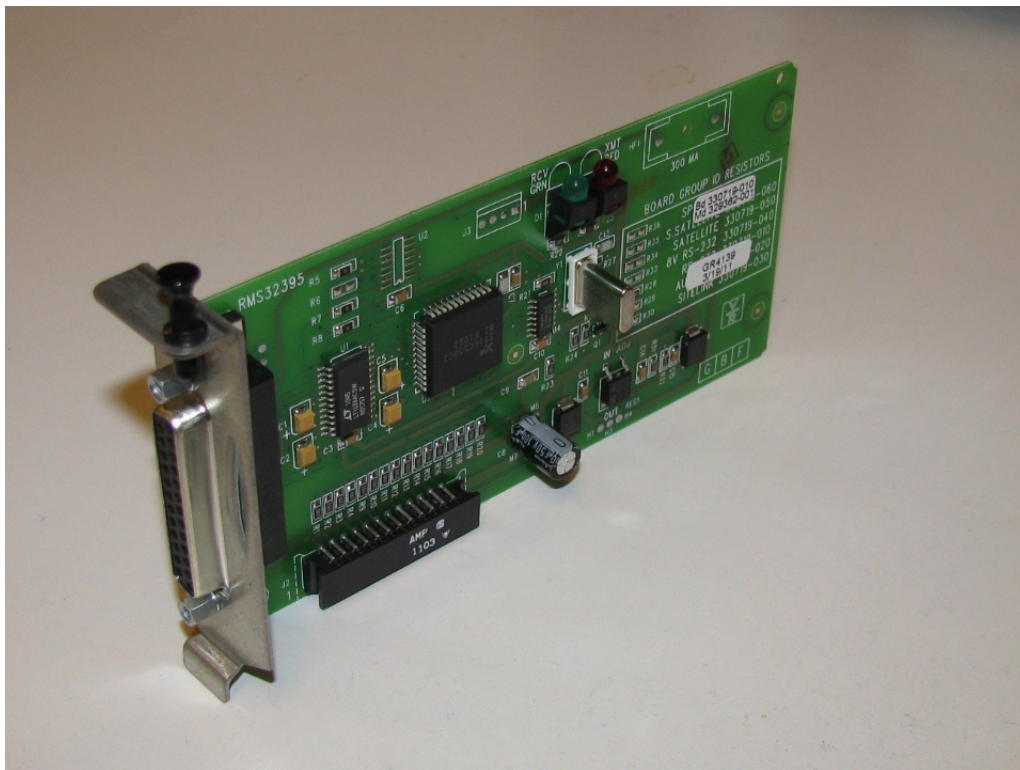



Figure 1A-4
Typical VST-ECS-CS3 Membrane Processor

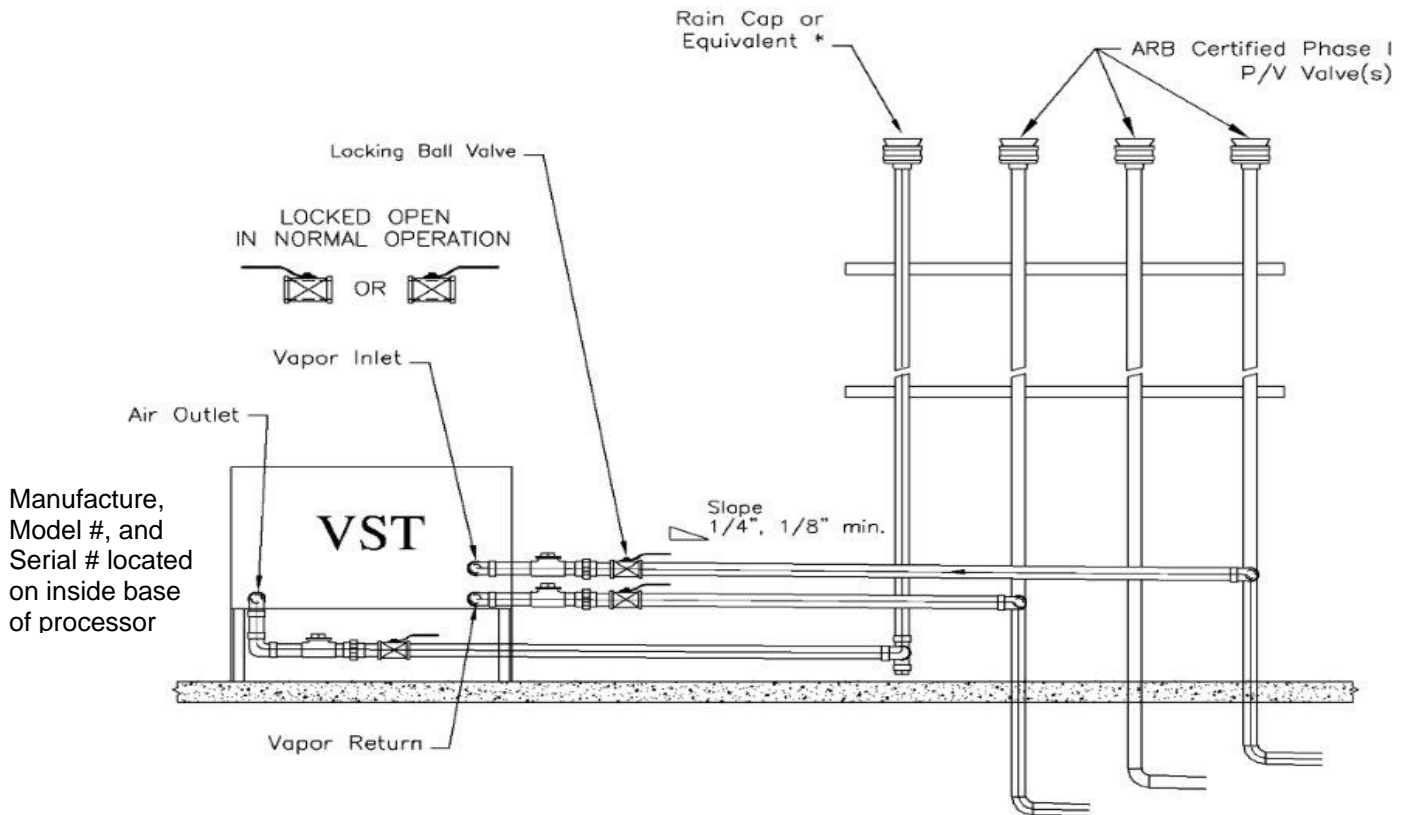


CAUTION: THE HANDLES ON THE LOCKING BALL VALVES MUST NOT BE REMOVED

* If a P/V valve is used, the internal components MUST be removed to allow open venting to the atmosphere.

Figure 1A-5
Veeder-Root Vapor Pressure Sensors

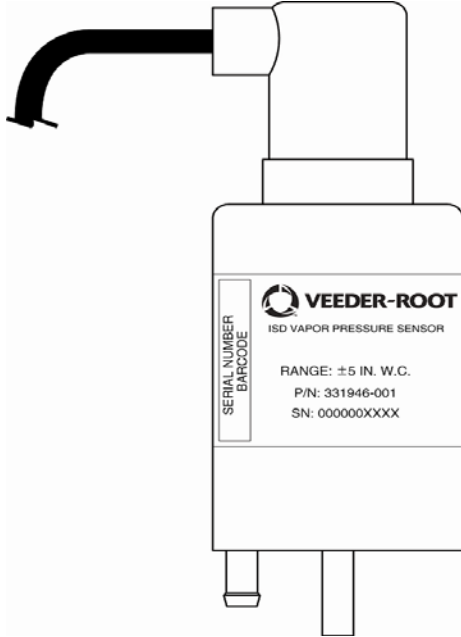

Veeder-Root Model # 331946-001
Vapor Pressure Sensor

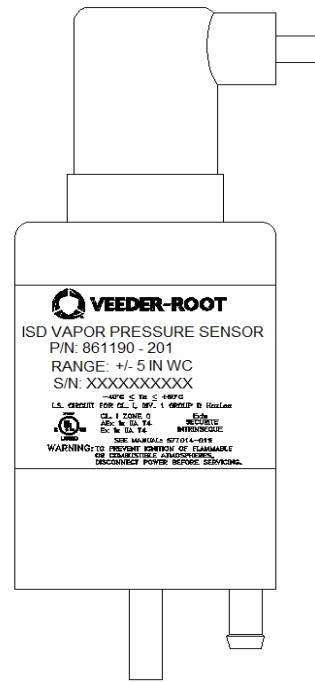

Veeder-Root Model # 861190-201
Low Powered Vapor Pressure Sensor



Veeder-Root Model # 330020-717
Dryer Tube (Optional)

Figure 1A-6
Typical Veeder-Root Vapor Polisher

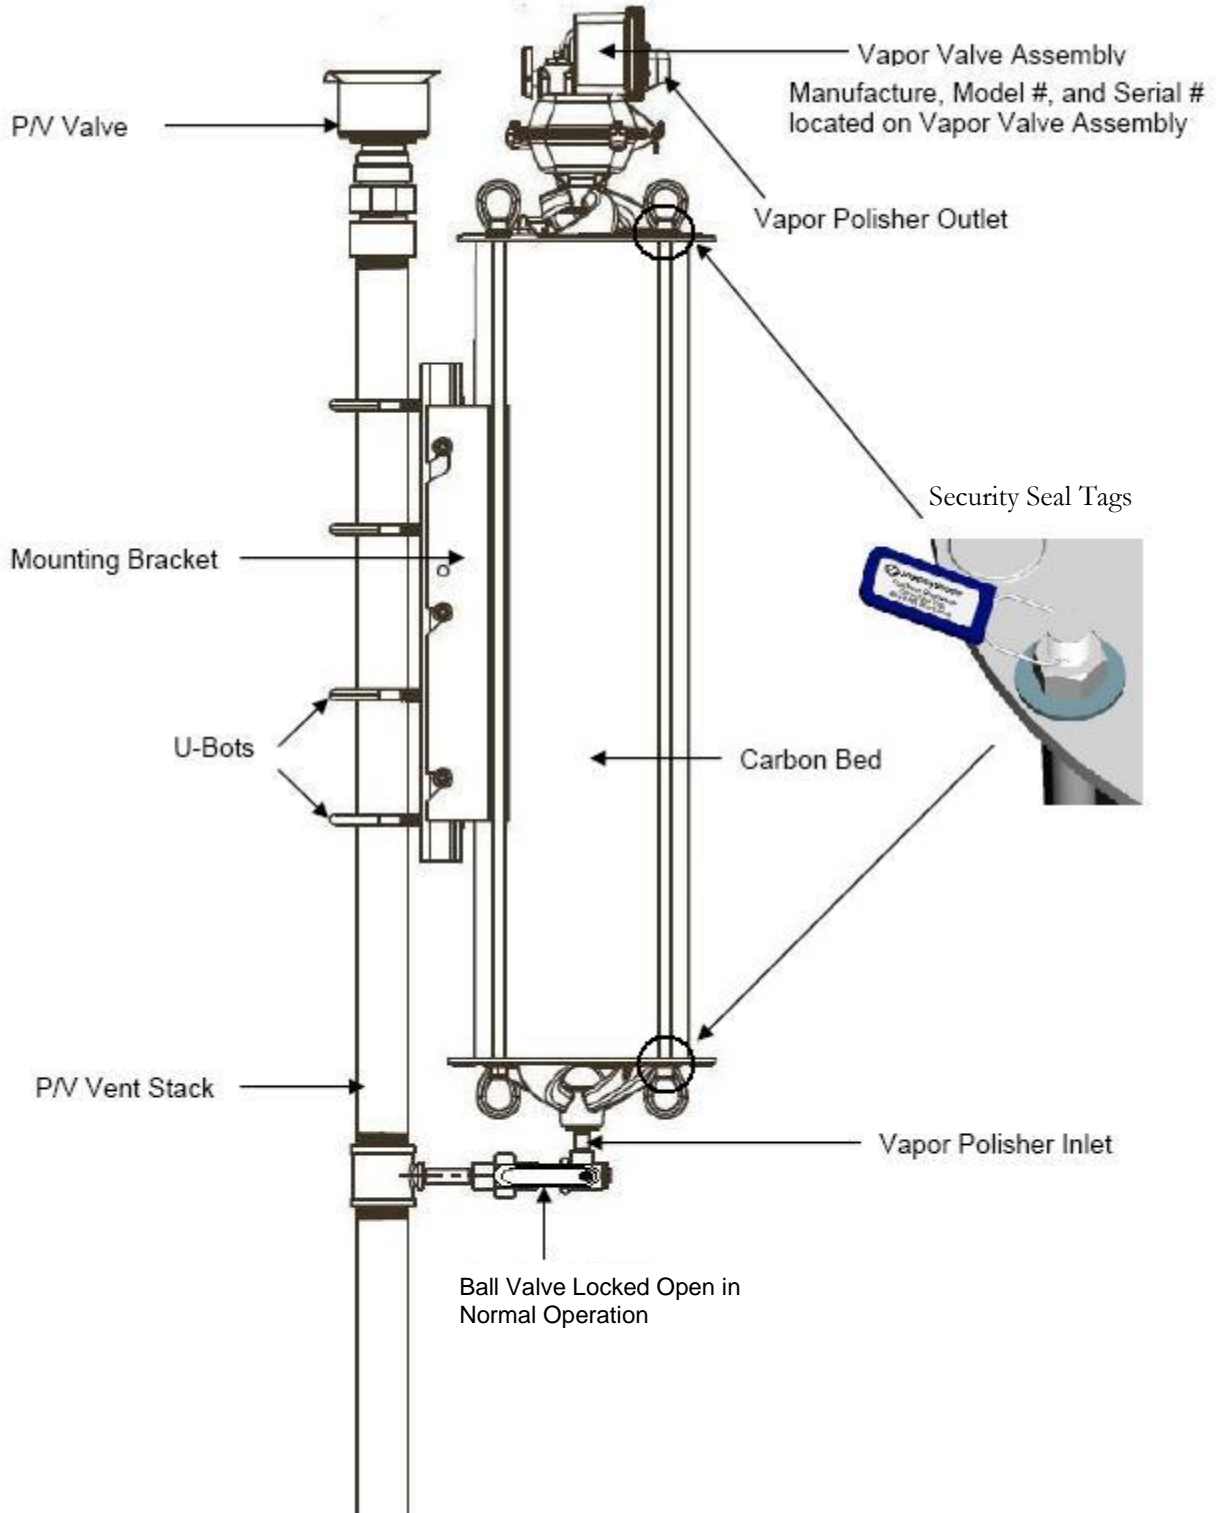


Figure 1A-7
Veeder-Root 329356-004, 332250-001
Smart Sensor Interface Module

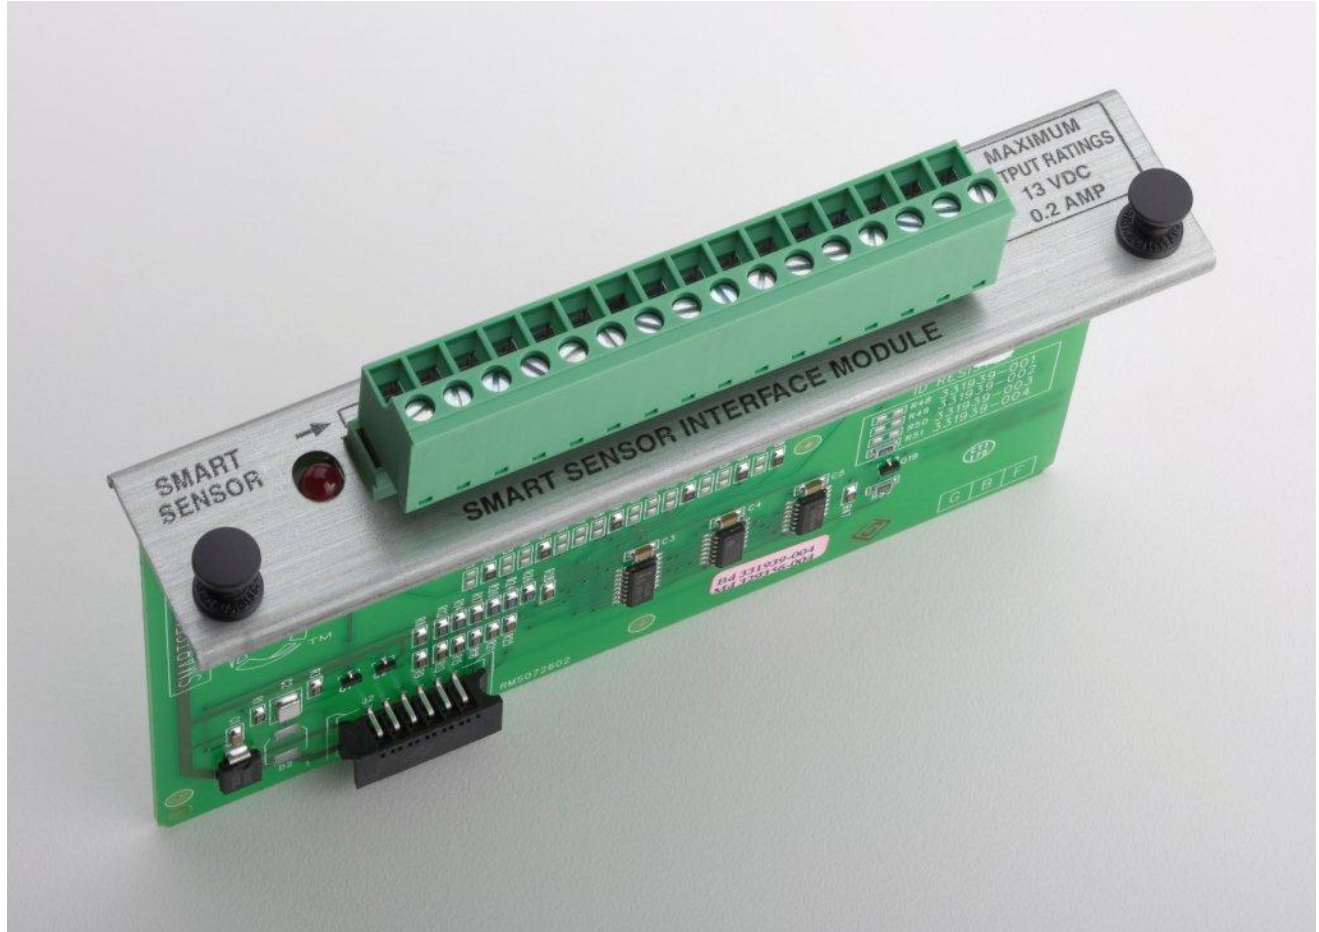


Figure 1A-8
Veeder-Root 332374-XXX
Balance Low Pressure Drop Vapor Flow Meter

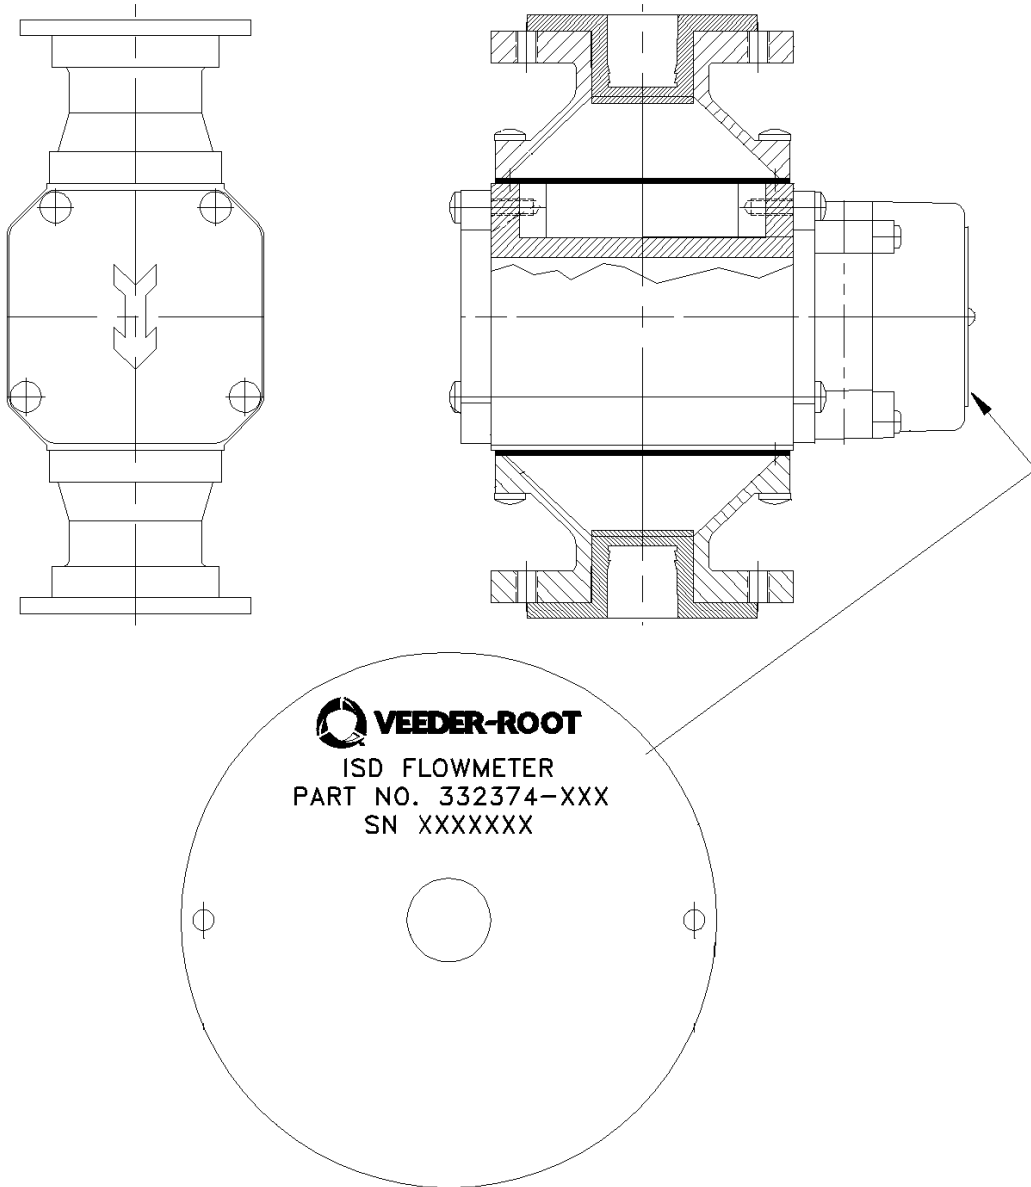


Figure 1A-9
Veeder-Root Optional Wireless Components



Wireless TLS RF Console



Wireless Receiver



Wireless Repeater



Wireless Transmitter






Wireless Battery Pack



Wireless Enclosure

Figure 1A-9 (continued)
Typical Configuration for Veeder-Root Wireless Components

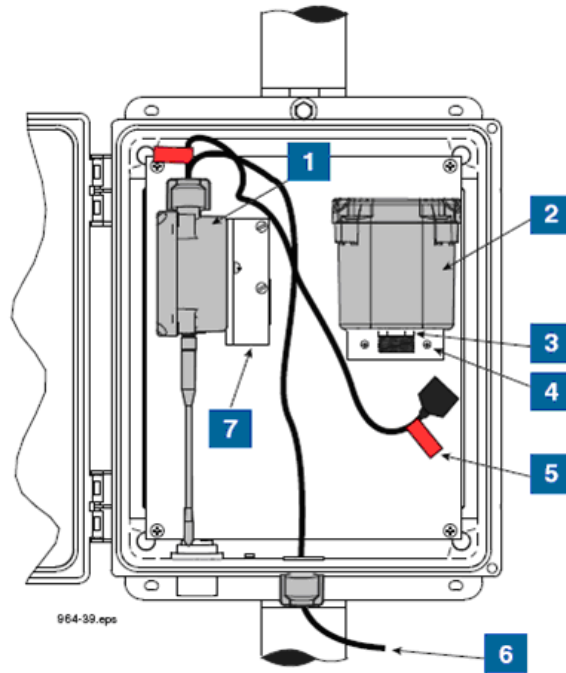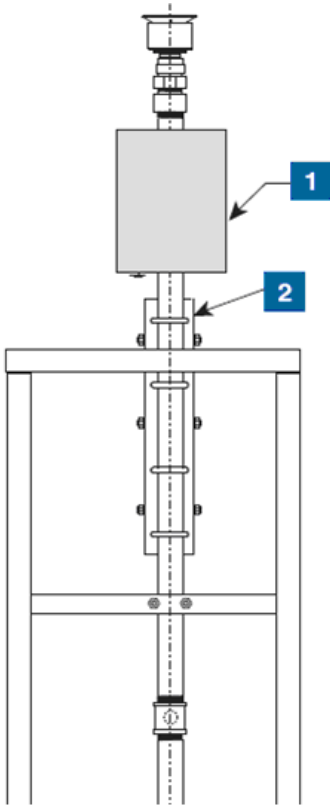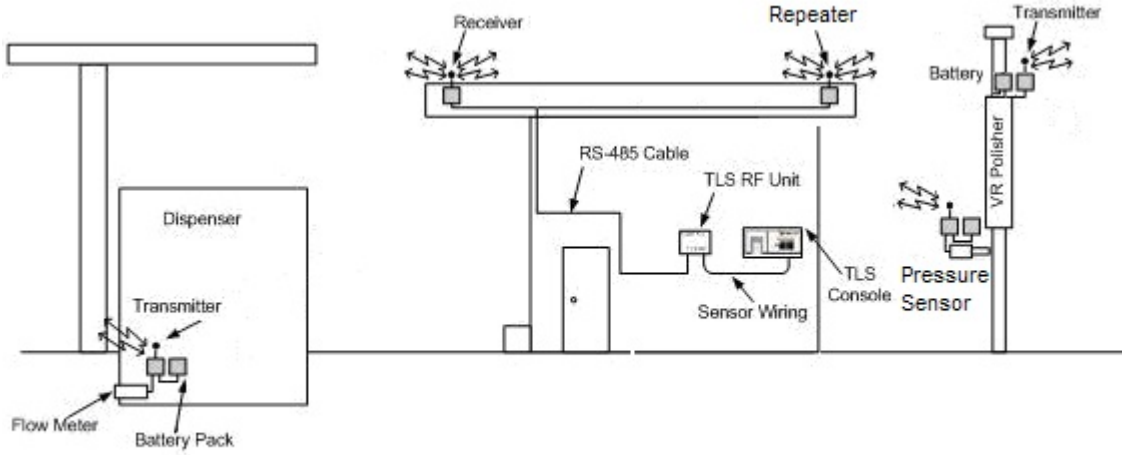

- 1. CCVP transmitter/battery enclosure on vent stack
- 2. CCVP support bracket

- 1. Transmitter
- 2. Battery pack
- 3. Thin hex nut
- 4. Attach Battery L bracket using two #10 taptite screws
- 5. Battery caution label attached to battery cable (2 places)
- 6. Cable from CCVP
- 7. Attached Transmitter L bracket using two #10 taptite screws

Figure 1A-10
Healy Model 9961 Clean Air Separator

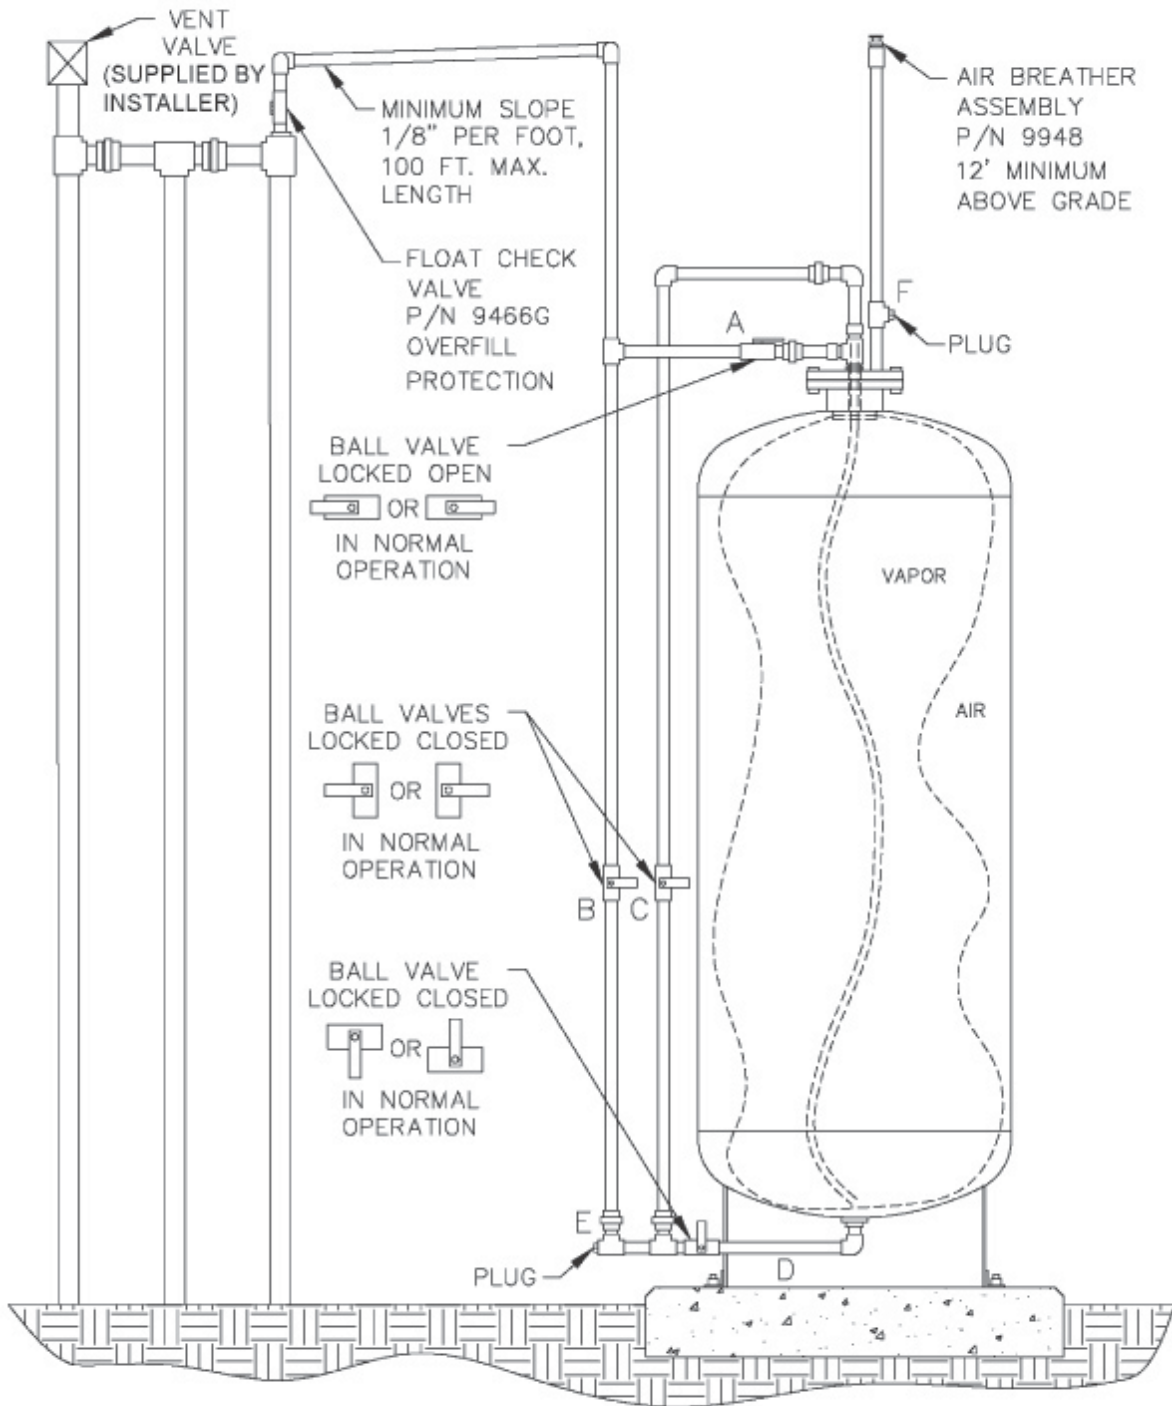


Figure 1A-11
Healy Model 9961 Clean Air Separator



Figure 1A-12
Healy Model 9961H Clean Air Separator

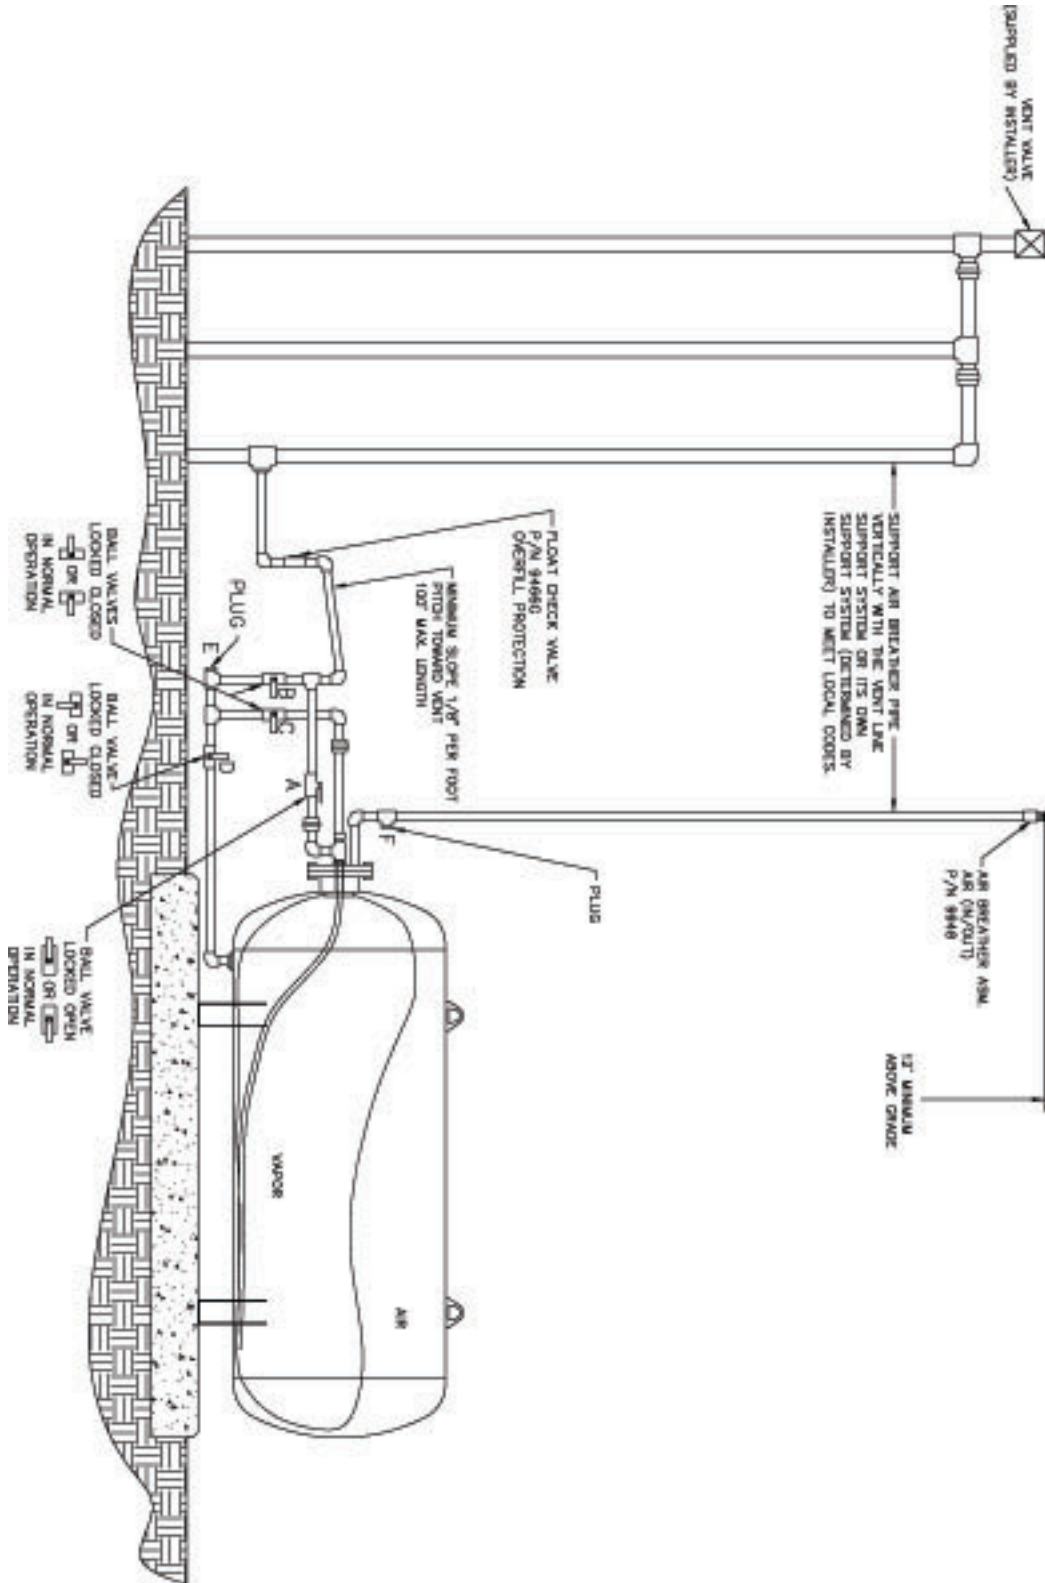


Figure 1A-13
Healy Model 9961H Clean Air Separator

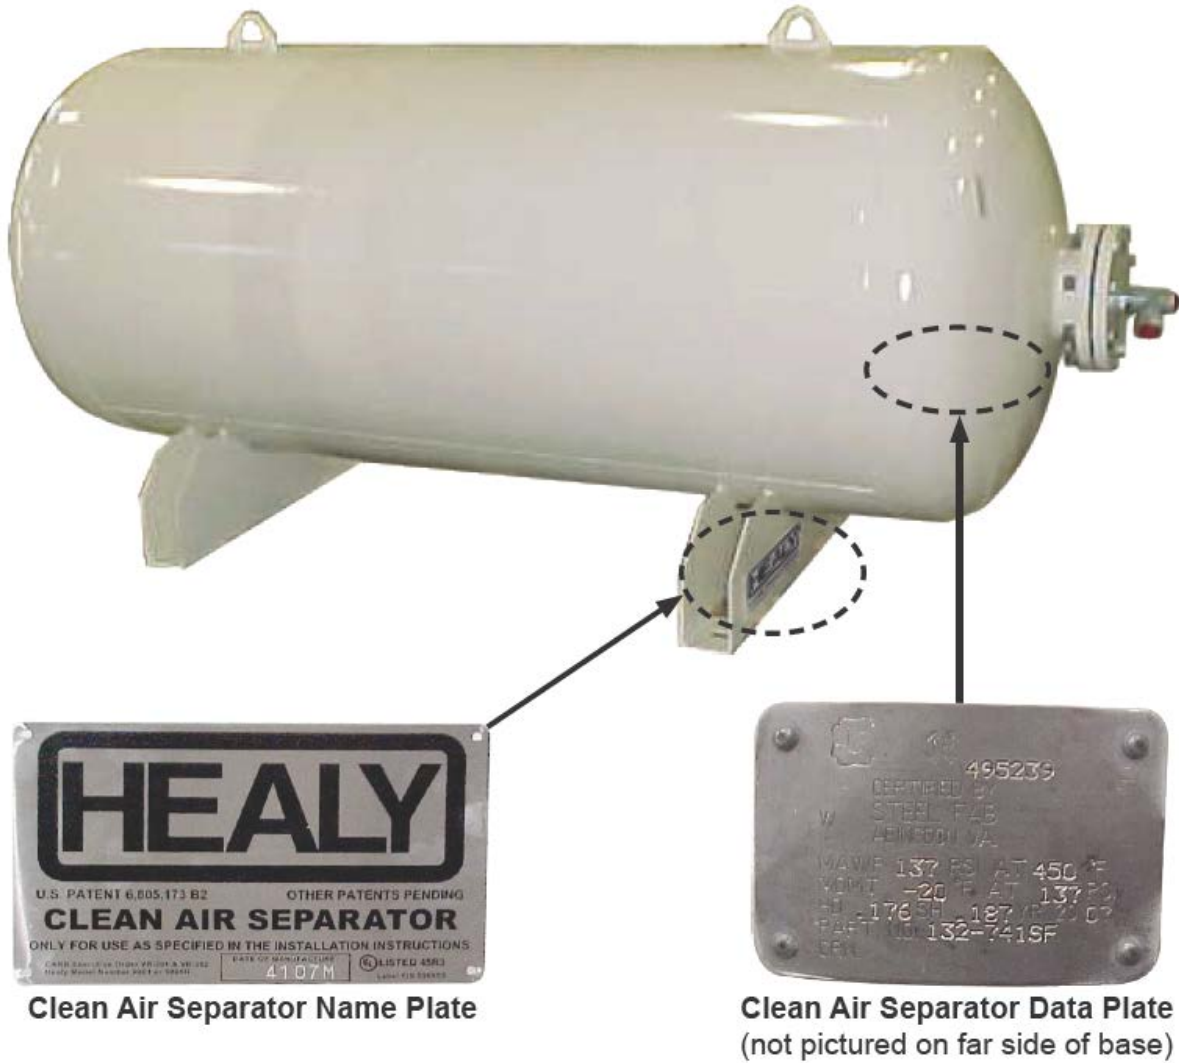


Figure 1A-14
Typical Liquid Condensate Trap Installed Below the Transition Sump

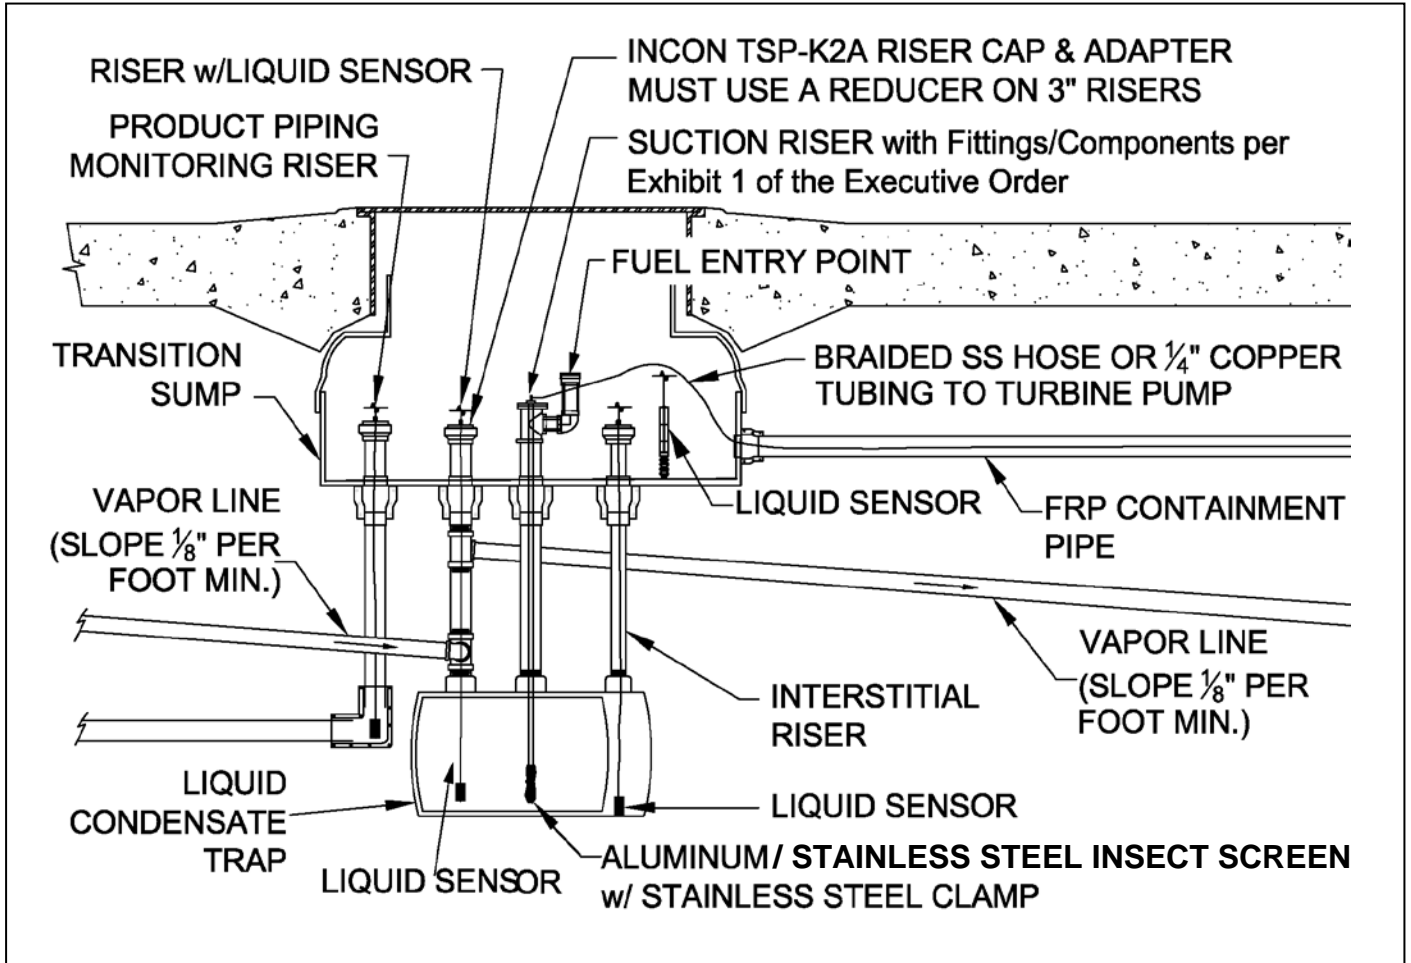


Figure 1A-14 (continued)
Typical Liquid Condensate Trap Installed Inside the Transition Sump

Note: A Liquid Condensate Trap installed inside a liquid AND vapor tight transition sump that is monitored with a liquid sensor can be single walled (if installed before July 1, 2004).

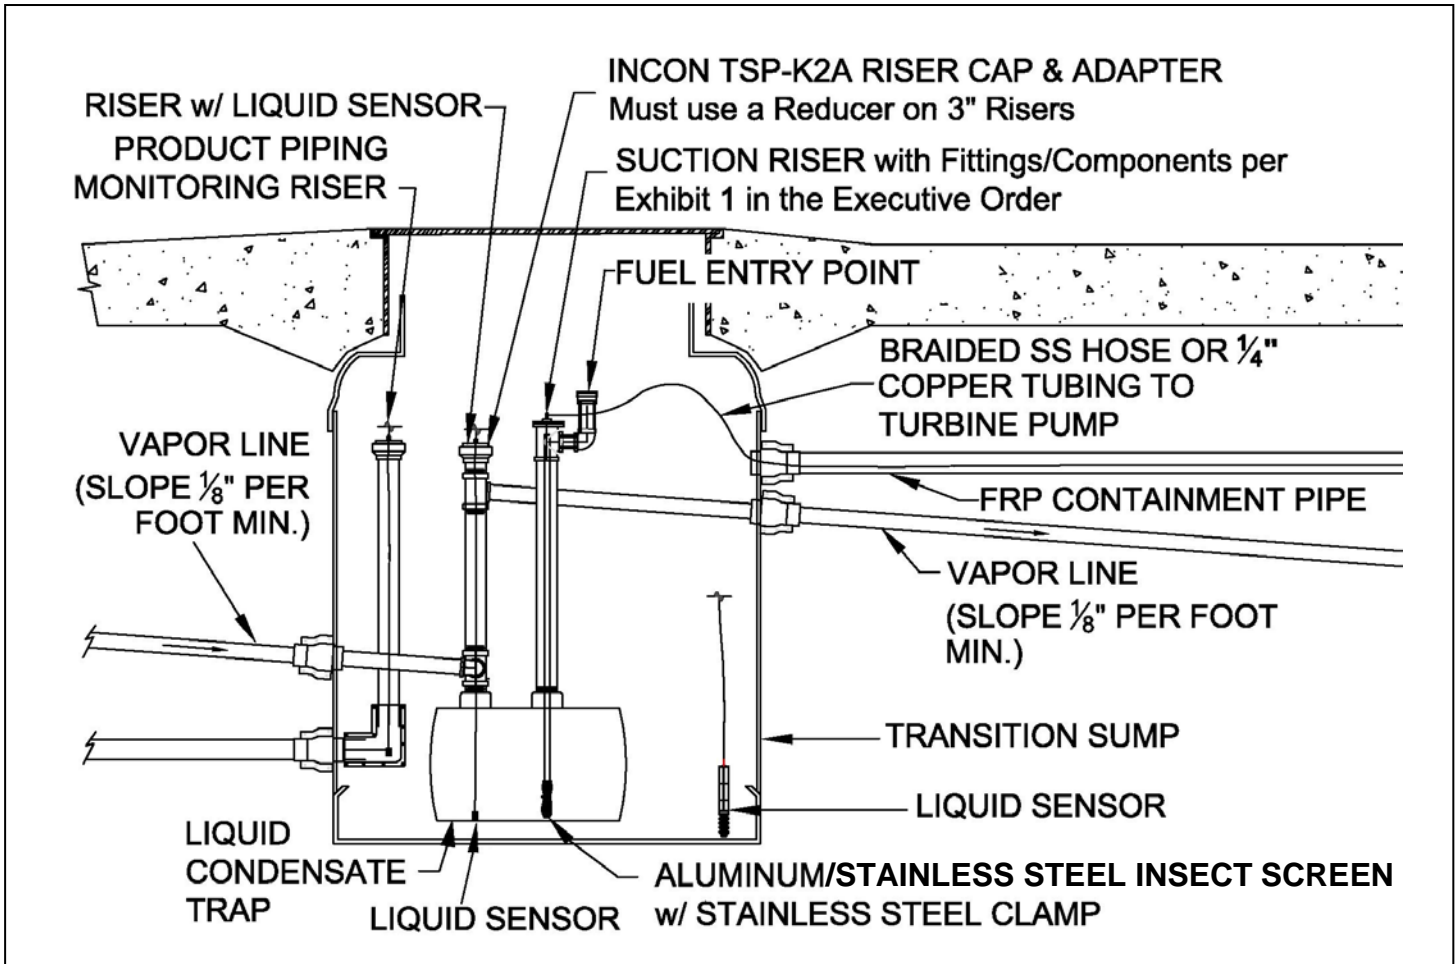


Figure 1A-15
Hirt VCS 100 Thermal Oxidizer and Indicator Panel

VCS 100 Identification Plate




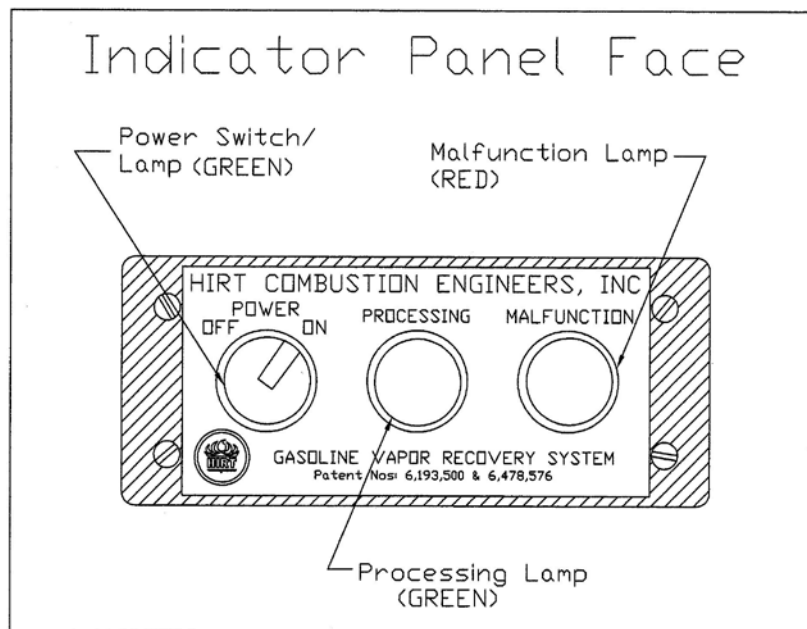



Figure 1A-15 (continued)
Typical Hirt VCS100 Thermal Oxidizer Processor

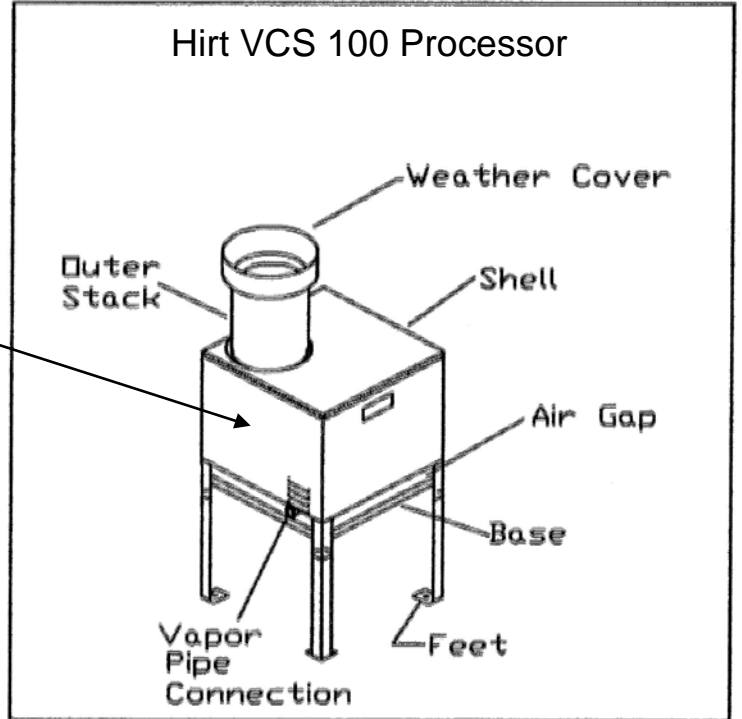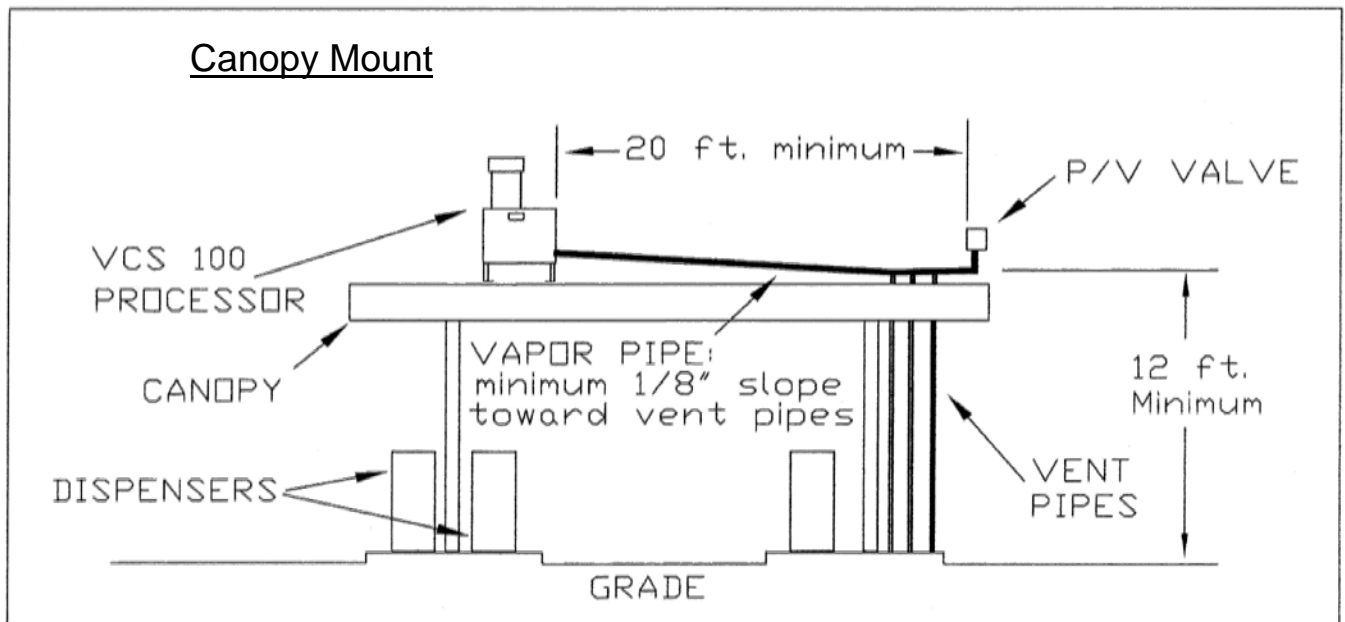

**Figure 1A-16
Veeder-Root
Maintenance Tracker Technician Key**

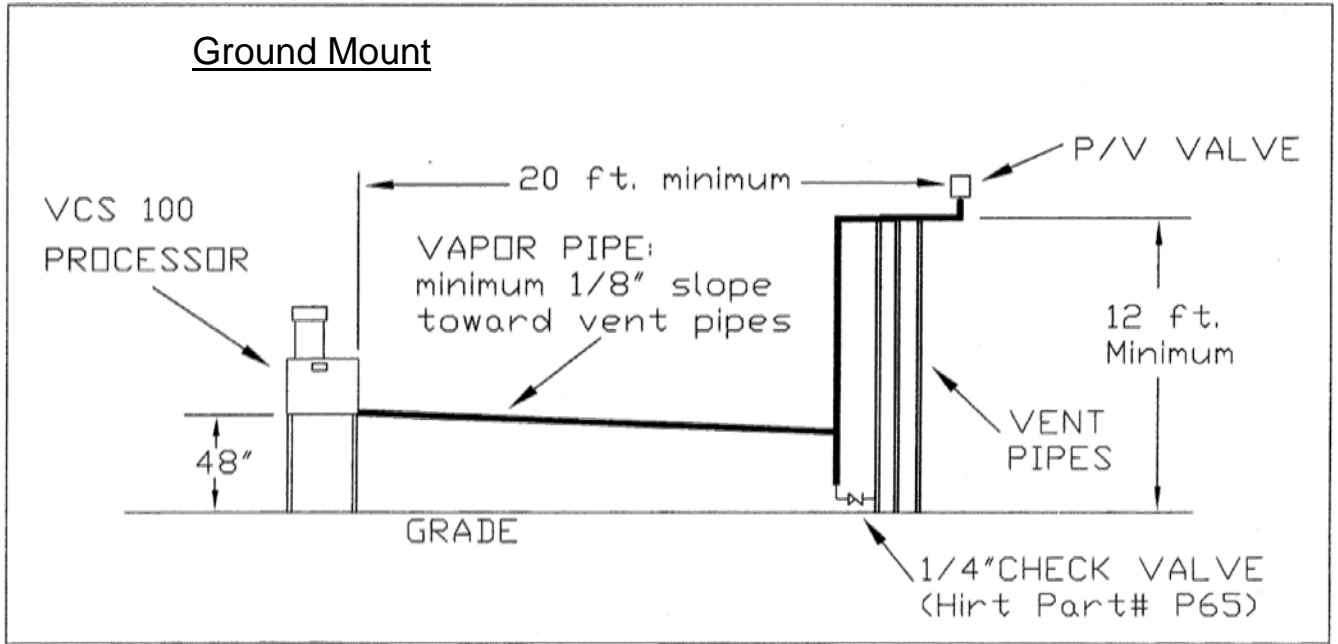


**Figure 1-A 17
Veeder-Root
RS232 Interface Modules
Required for Maintenance Tracker**

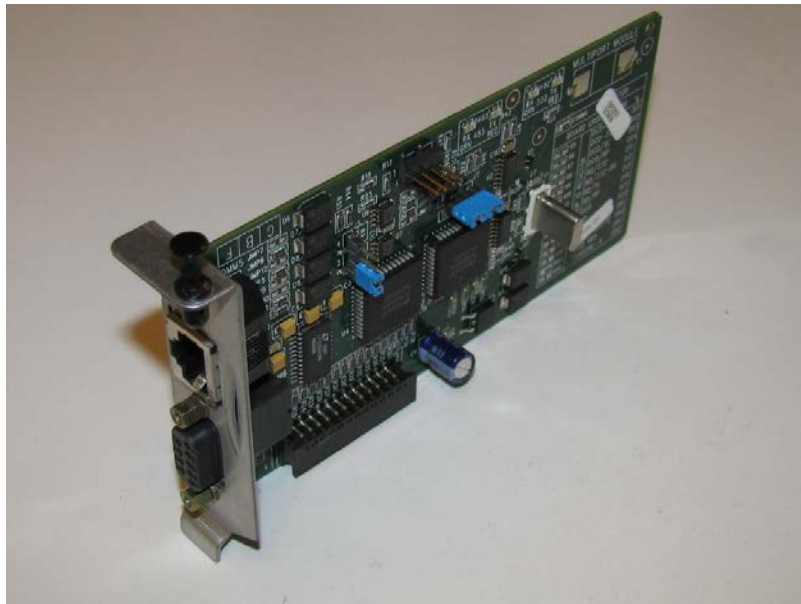

**Figure 1A-18
INCON TS-550**

**INCON TEMSXXXX/YV
INCON T550XXXX/YYYYV
INCON T5000XXXX/YYYYV**

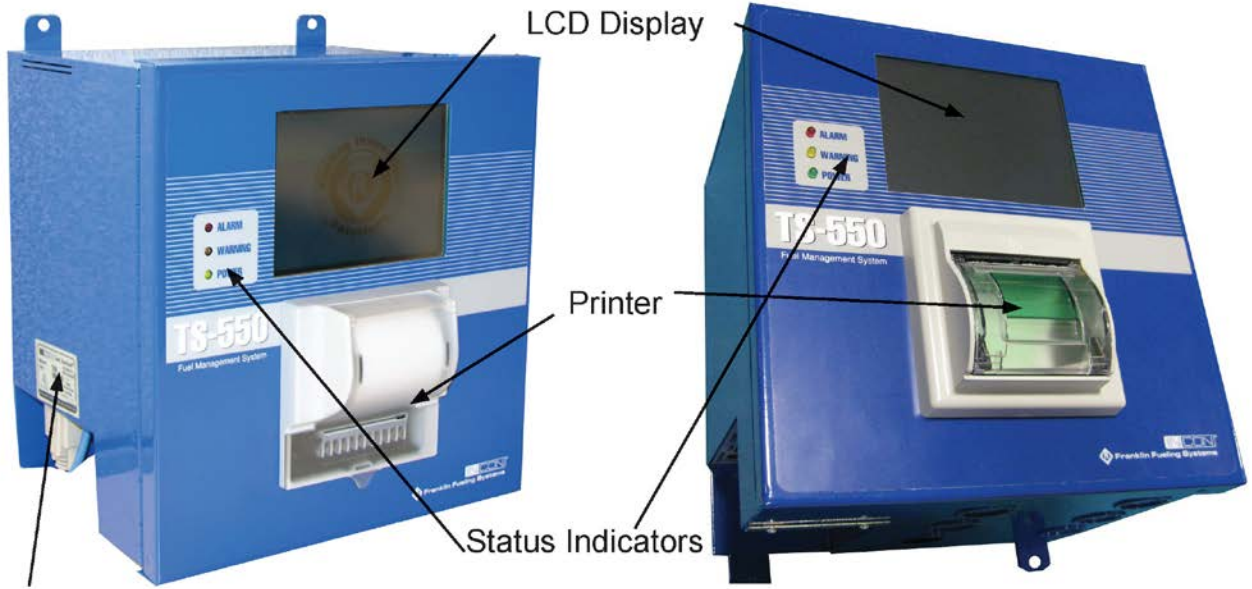

Label with console
serial and model
numbers

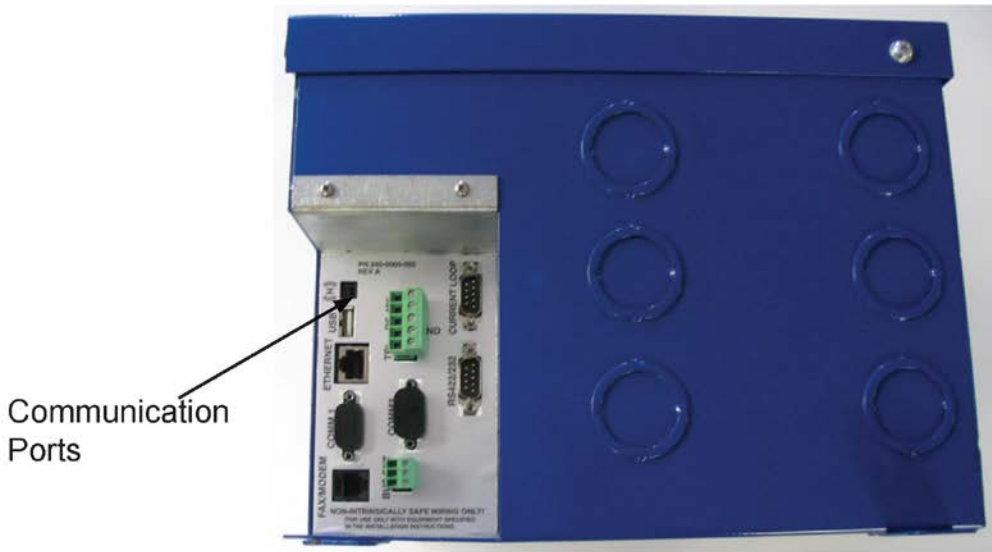


Figure 1A-19 INCON TS-VFM Vapor Flow Meter

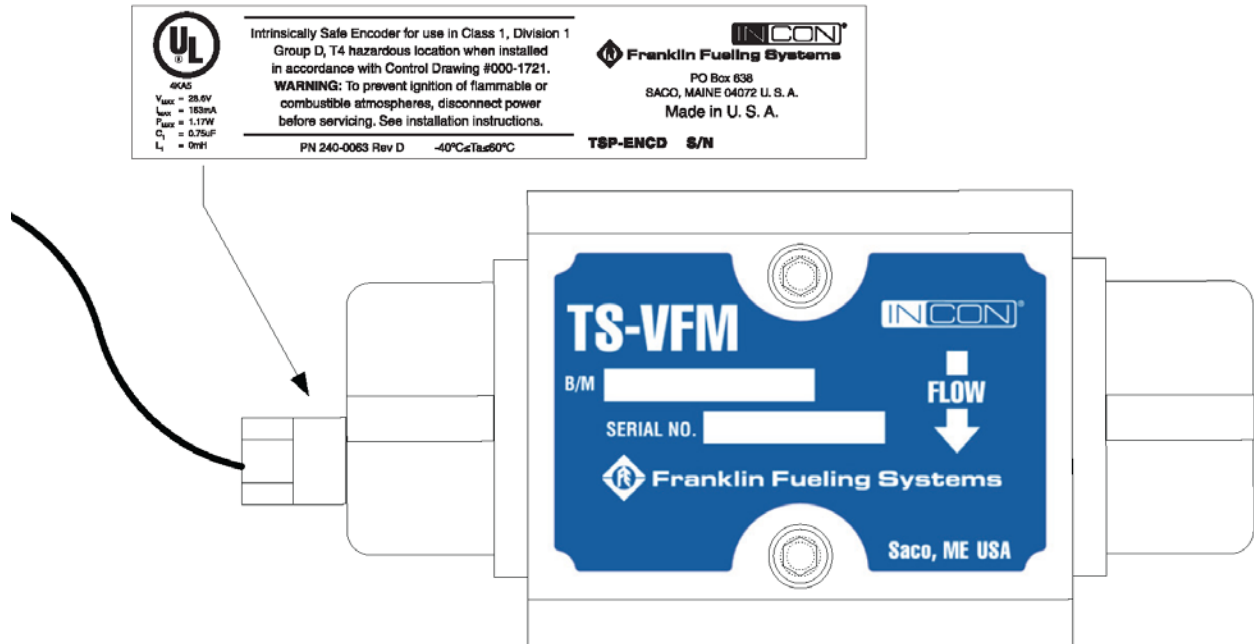


Figure 1A-20 INCON TS-VPS Vapor Pressure Sensor



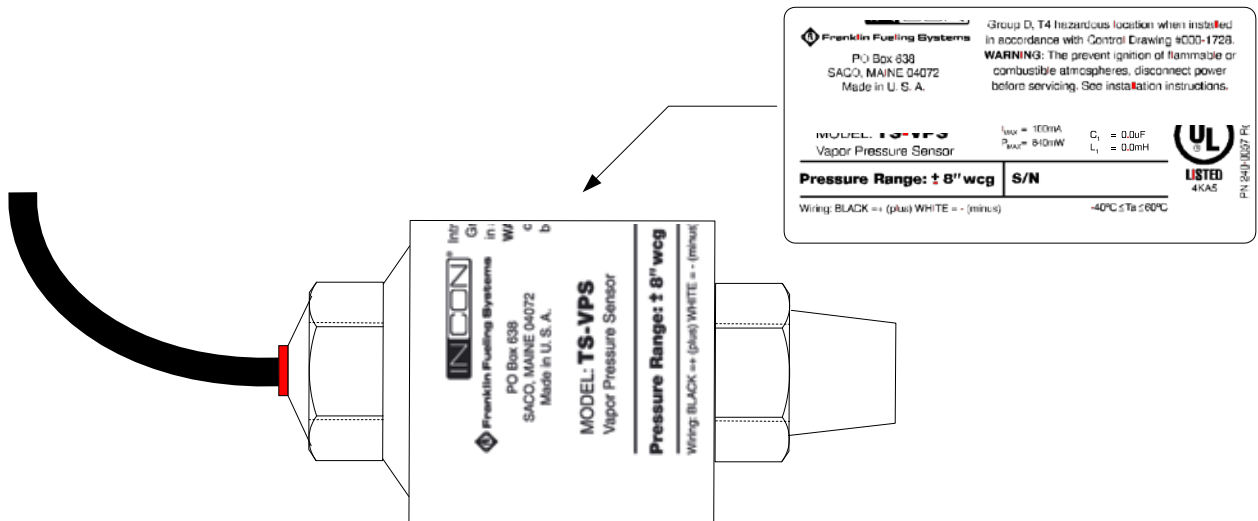


Figure 1A-21
INCON TS-DTU / P
Data Transfer Unit

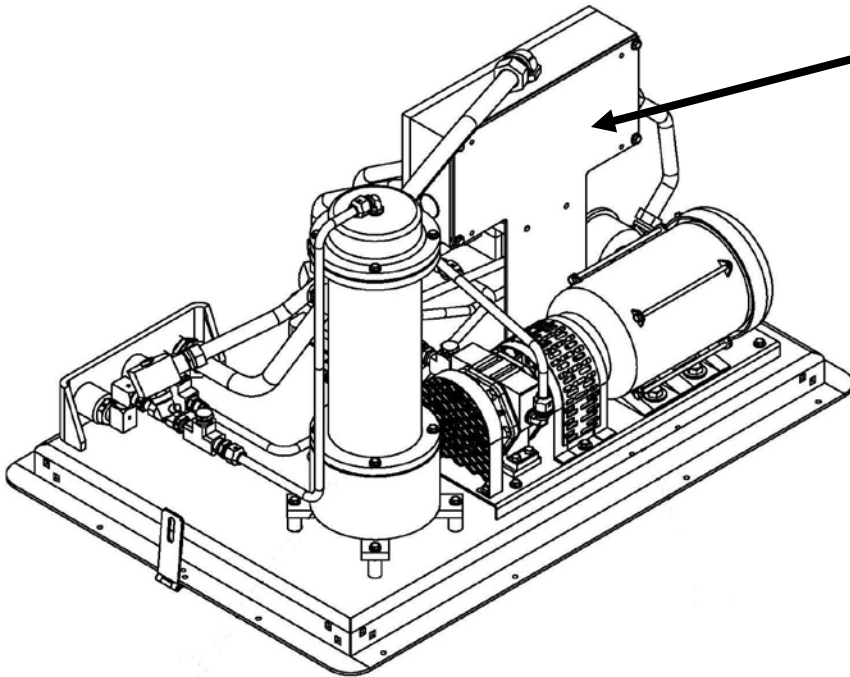


Label with DTU Serial
Number and ID Number

Figure 1A-22
VST Green Machine Processor

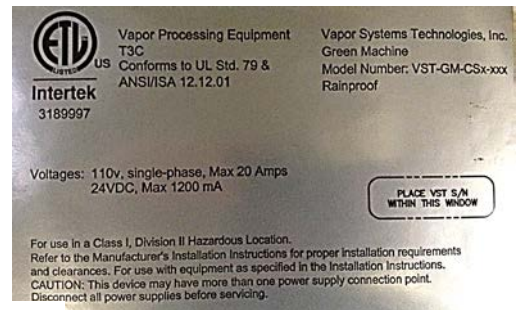


Label with serial number is located inside the Green Machine housing on the electrical junction box.


Figure 1A-22 continued
VST Green Machine, Typical Ground Mounted Configuration

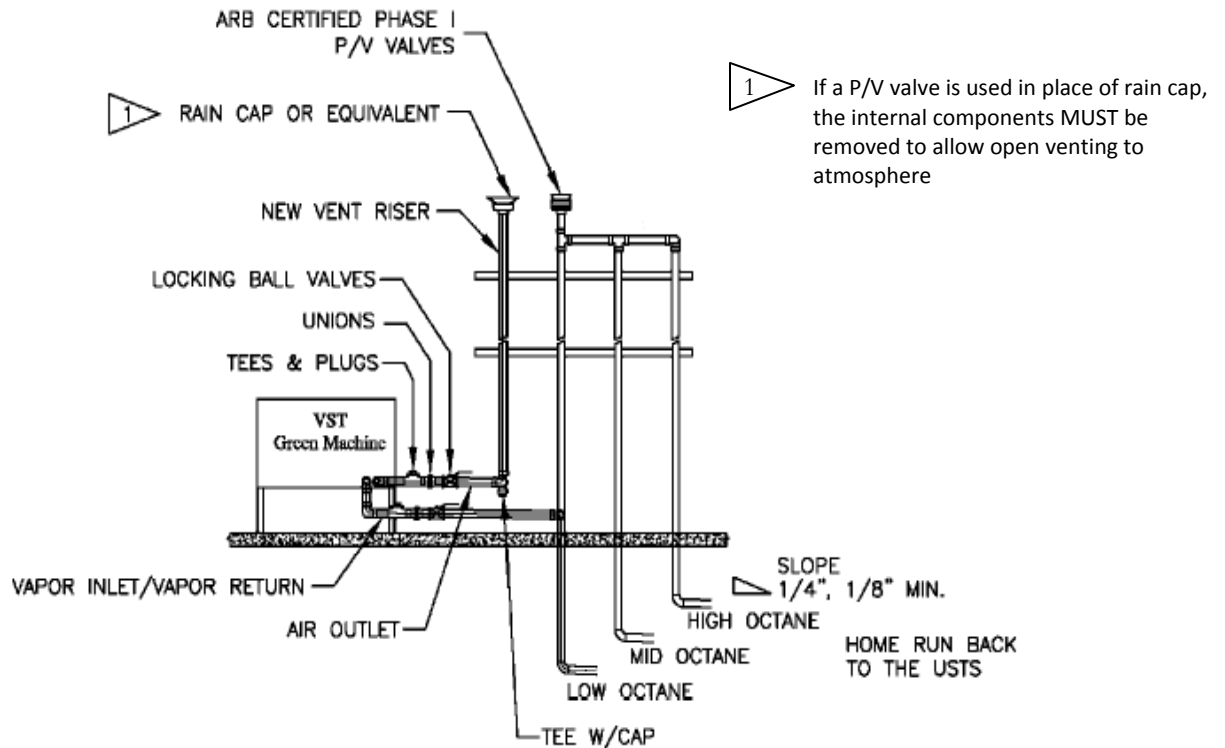

VST Green Machine, Typical Vent Mounted Configuration

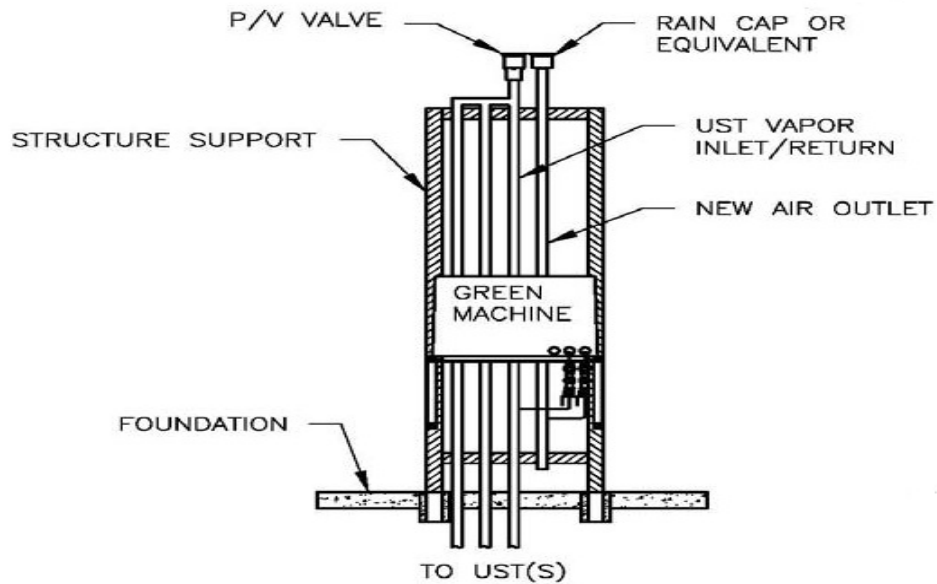

**Figure 1A-22 Continued
VST Green Machine Control Panel**

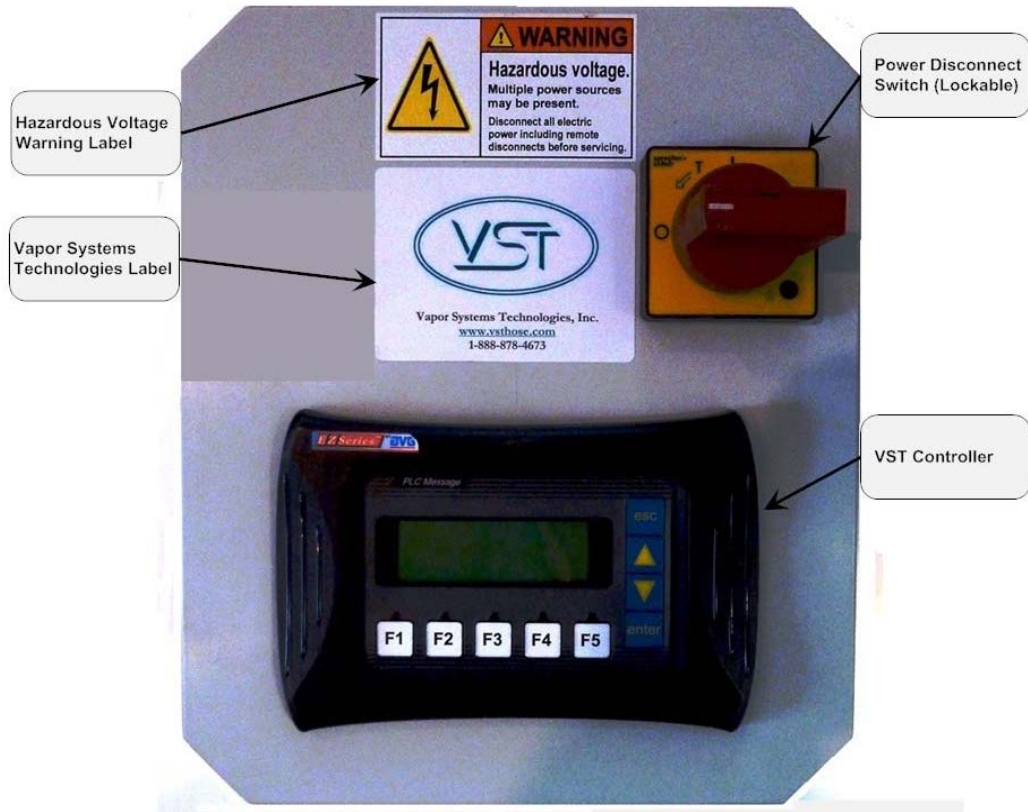

VST Green Machine Port Combiner

