

**EXHIBIT 1<sup>1</sup>**  
**Equipment List**

**Hanging Hardware**

<b>Component</b>	<b>Manufacturer / Model</b>
<b>Nozzle</b>	EMCO Models A4005EVR, RA4005EVR (Rebuilt) Or VST Model VST-EVR-NB (G2), VST-EVR-NB (G2 Rebuilt) (Figure 1A-1)
<b>Coaxial Curb Hose<sup>2</sup></b>	ContiTech Model Maxxim Premier Plus (532-365-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location (“NV” stamped on nozzle end) Or ContiTech Model Maxxim Premier Ultra (532-366-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location (“NV” stamped on nozzle end) Or VST Model VDV-EVR Series (Figure 1A-2)
<b>Coaxial Whip Hose<sup>2</sup></b>	ContiTech Model Maxxim Premier Plus (532-365-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location Or ContiTech Model Maxxim Premier Ultra (532-366-641-XXXZZ) XXX = Hose Length ZZ = Liquid Removal Pickup Location Or VST Model VSTA-EVR Series (Figure 1A-2)
<b>Breakaway Coupling</b>	EMCO Models A4119EVR-X X = 020 or 020S (Factory Serviced) Or EMCO Models A4119EVR-X (Reconnectable) X = 020RC or 020RCS (Factory Serviced) Or VSTA-EVR-SBK (Reattachable)

<sup>1</sup> The local air district may require a permit application when changing between alternate components.

<sup>2</sup> Veyance brand name has changed to ContiTech

**Hirt - Thermal Oxidizer  
Processor Equipment List**

<b>Component</b>	<b>Manufacturer / Model</b>
<b>Hirt Thermal Oxidizer With Indicator Panel</b>	Hirt Model VCS 100-2 VaporTek® Processor (Figure 1A-3) Leg Attachments: 5" – M39 48" - M40
<b>Hirt 1/4" Check Valve (optional component)</b>	Hirt P65

---


**Liquid Condensate Trap  
Equipment List  
(If a Liquid Condensate Trap is Installed)**

<b>Component</b>	<b>Manufacturer / Model</b>
<b>Riser Adapter</b>	INCON model TSP-K2A (Figure 1A-4)
<b>In-Line Filter</b>	140 micron, Swagelok B-4F2-140 or SS-4F2-140, or equivalent (Figure 1A-4)
<b>Screen</b>	Aluminum Insect screen (18X14 mesh), or Stainless Steel Insect screen (18X18 mesh). (Figure 1A-4)
<b>Stainless Steel Hose Clamp</b>	Sized to secure screen to suction tube. (Figure 1A-4)
<b>Liquid Sensor<sup>3</sup></b>	Must have an audible and visual alarm (Figure 1A-4)
<b>Liquid Condensate Trap<sup>4</sup></b>	Any capacity, manufacturer, make and model (Figure 1A-4)


<sup>3</sup> Must meet applicable State Water Resources Control Board (SWRCB) requirements (e.g. LG-113)

<sup>4</sup> Aluminum capacity tag must be attached to LCT per IOM


**Figure 1A-1**  
**EMCO Model A4005EVR Nozzle**

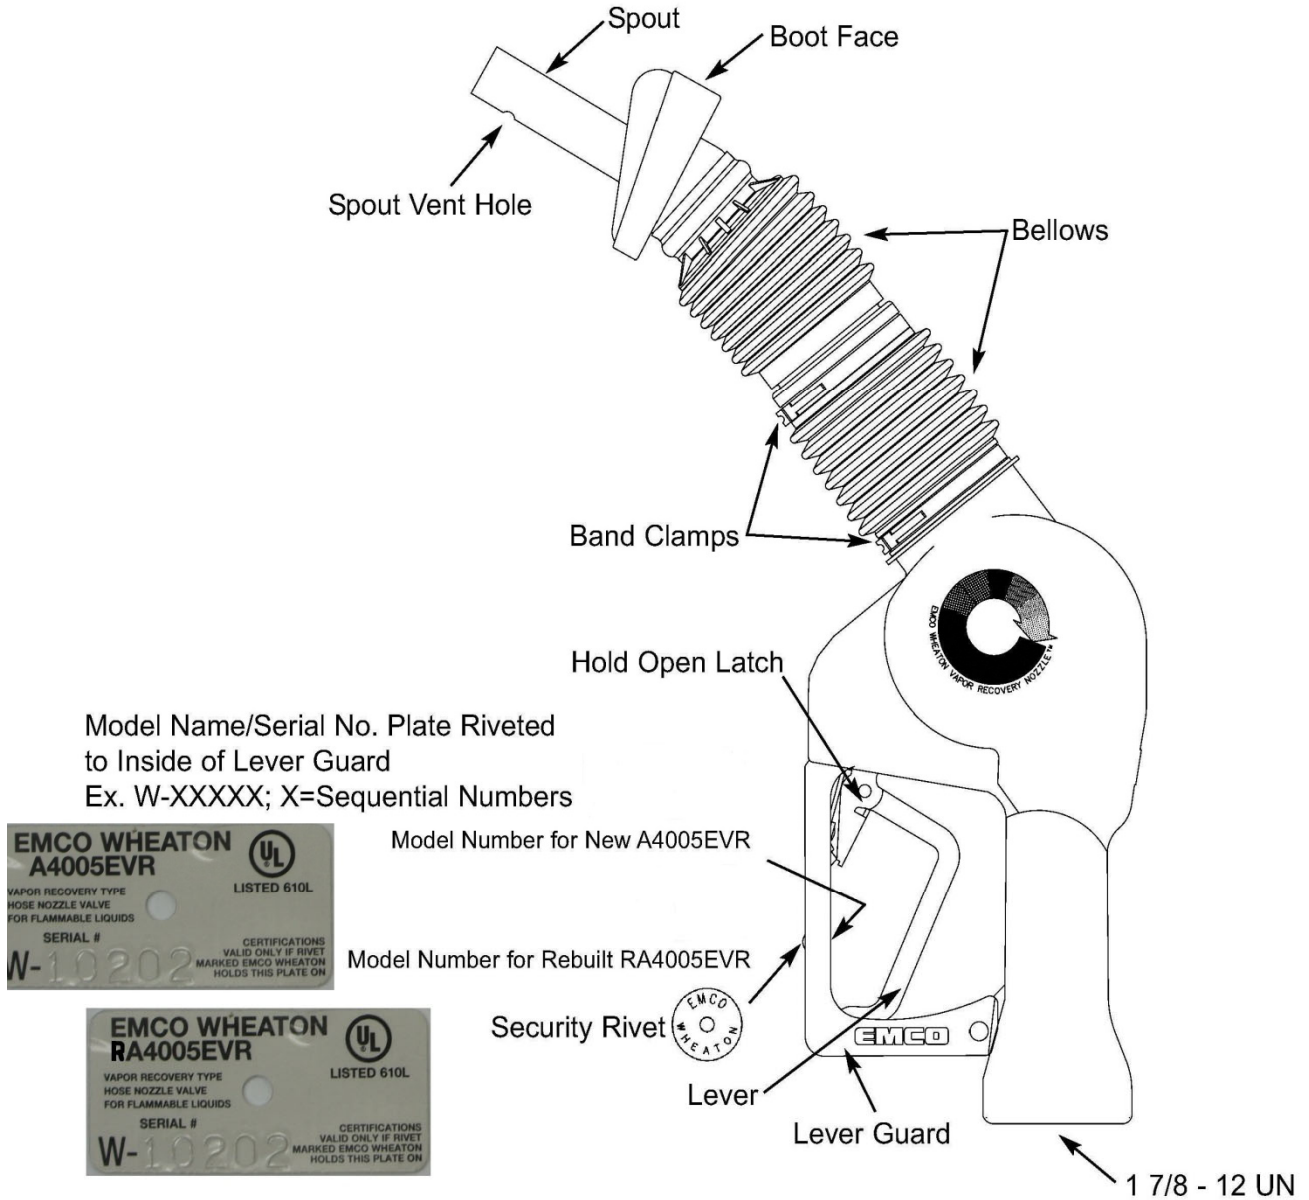

**Figure 1A-1 (continued)**  
**VST Model VST-EVR- NB (G2) Nozzle**

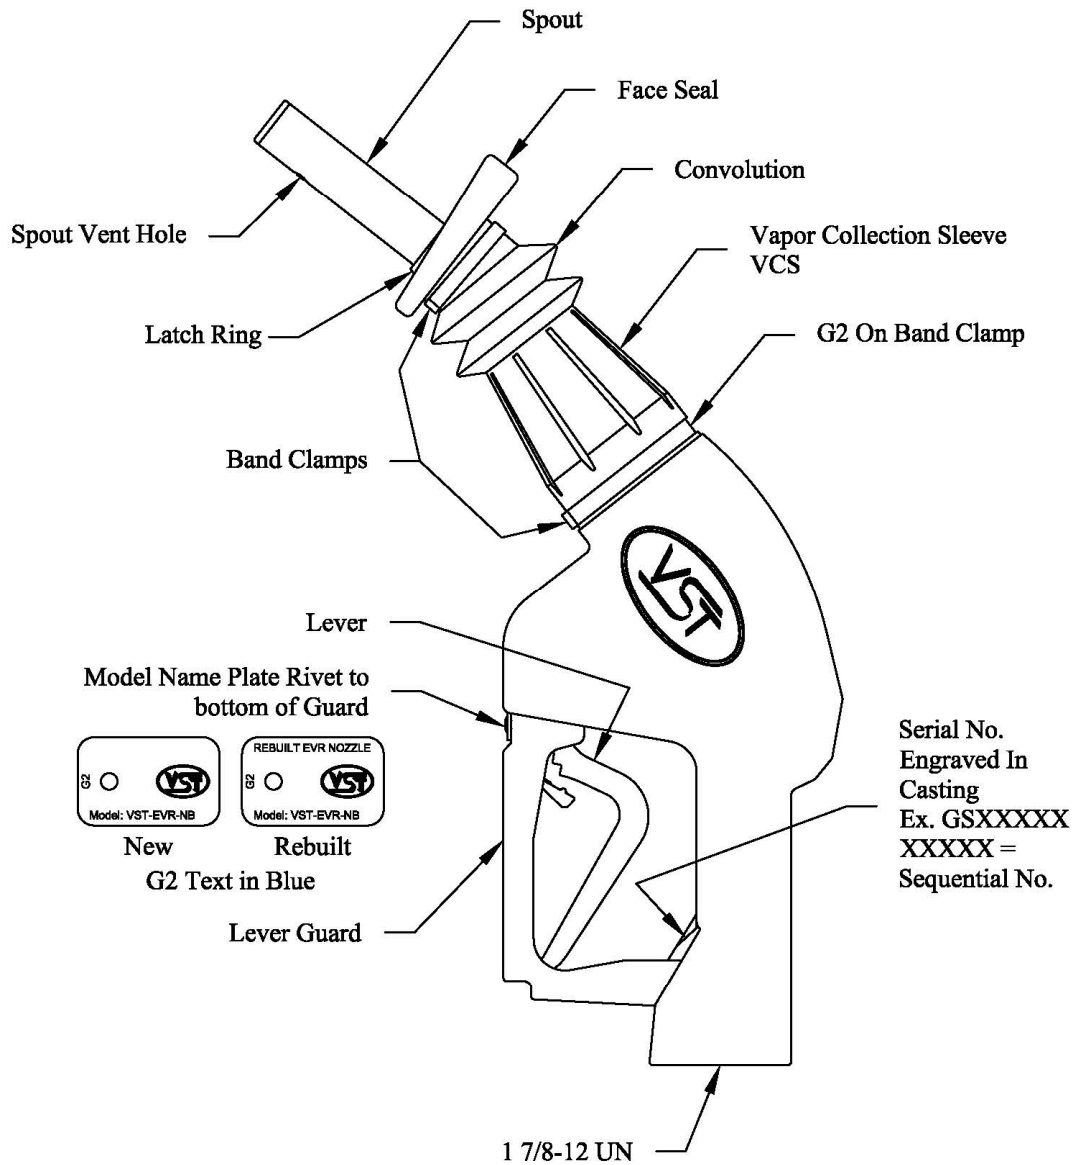

**Figure 1A-2**  
**EMCO Hanging Hardware**  
(Nozzle and Safe Break Valve)

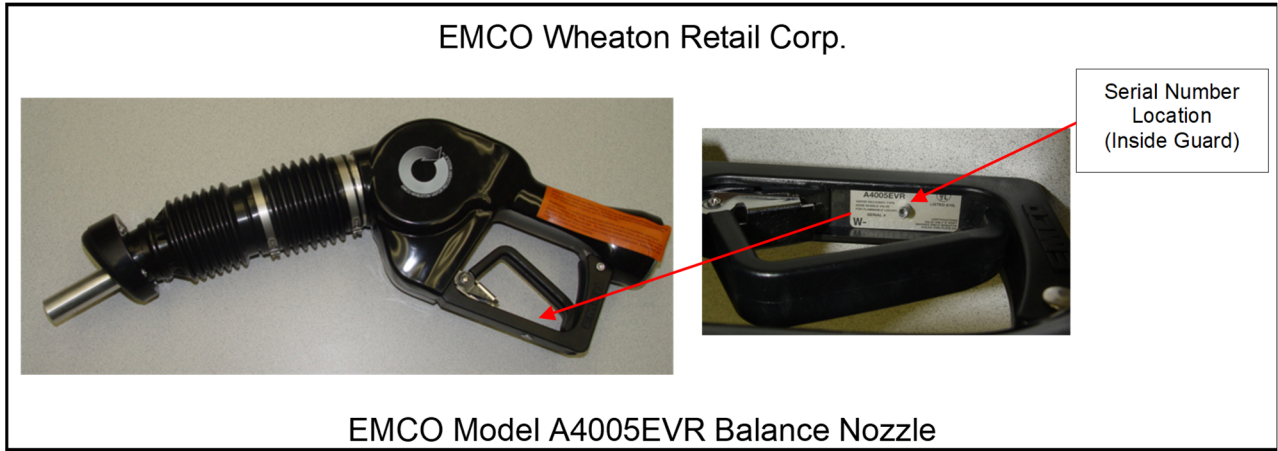

**Figure 1A-2 (continued)**  
**VST Hanging Hardware**  
(Nozzle and Breakaway Coupling)



**Figure 1A-2 (continued)**  
**VST Hanging Hardware**  
(Coaxial Curb Hose and Coaxial Whip Hose)

Curb Hose  
Ferrule Sleeve  
Identification





**Figure 1A-2 (continued)**  
**ContiTech USA, Inc. Hanging Hardware**  
(Curb and Whip Hoses)

Coaxial Whip Hose Model: Maxim Premier



Coaxial Curb Hose Model: Maxim Premier Plus



Serial Number Location



Coaxial Whip Hose: Maxim Premier Ultra



Coaxial Curb Hose: Maxim Premier Ultra






Serial Number Location






**Figure 1A-3**  
**Hirt VCS 100-2 VaporTek® Thermal Oxidizer and Indicator Panel**

VCS 100-2 VaporTek® Identification Plate

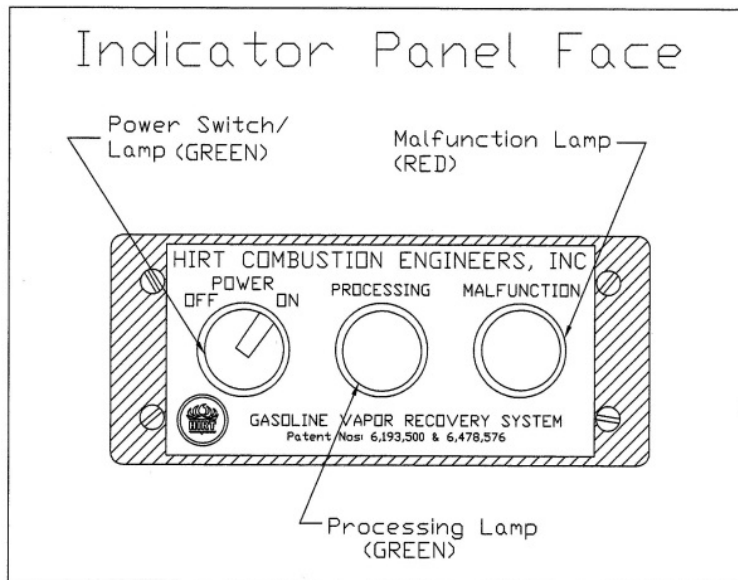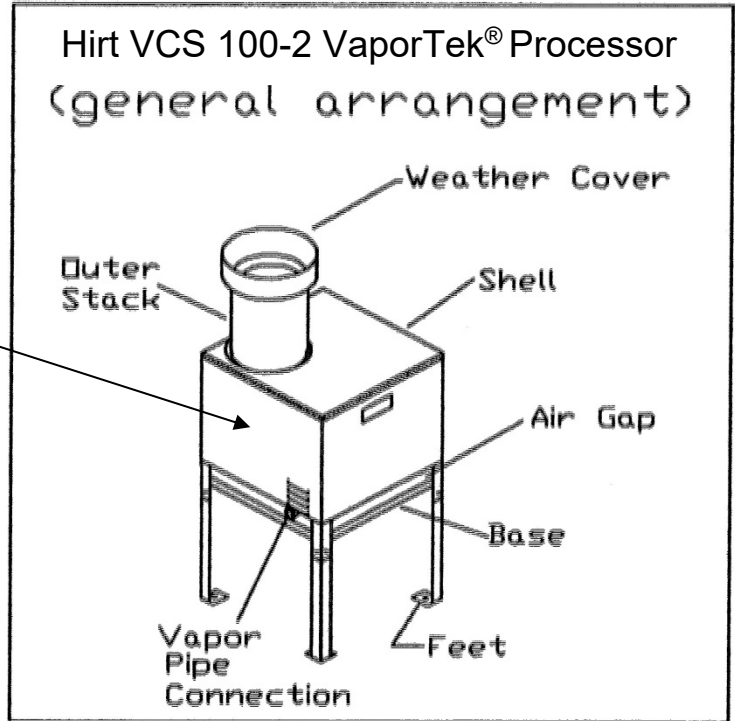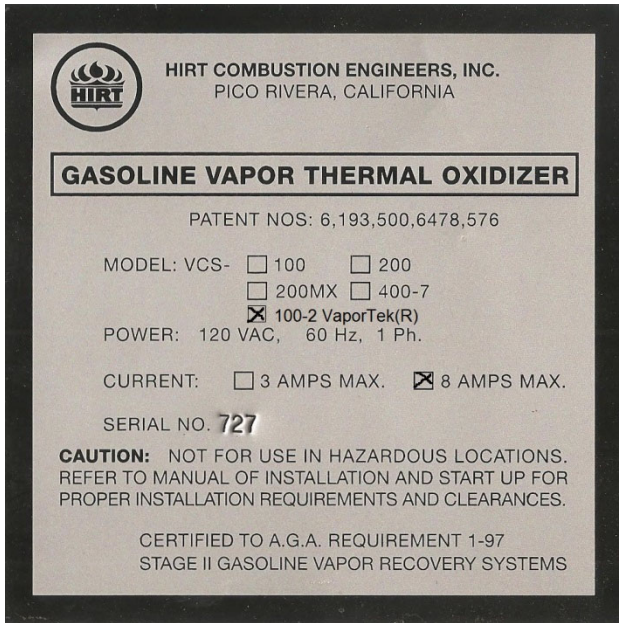

**Figure 1A-3 (continued)**  
**Typical Hirt VCS 100-2 VaporTek® Thermal Oxidizer Processor**

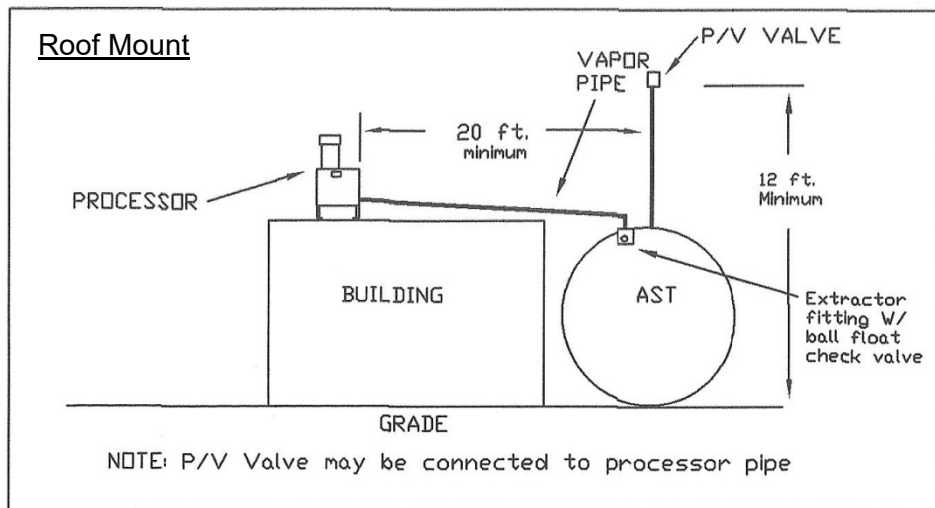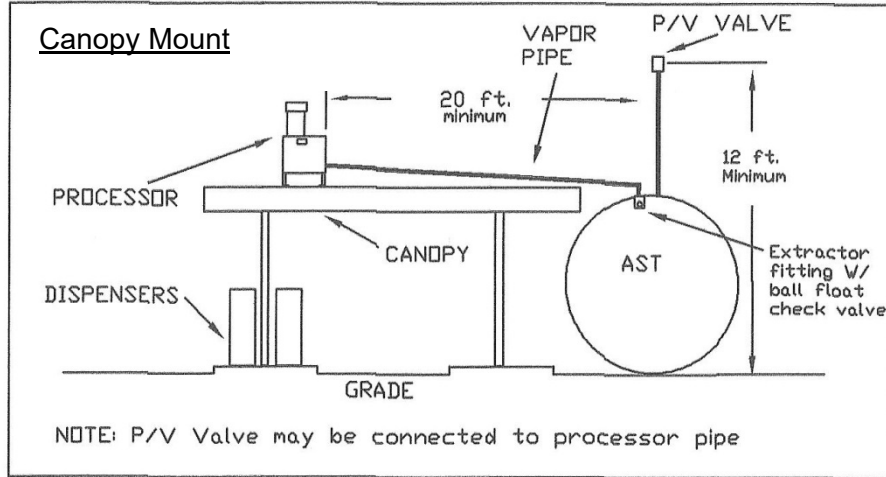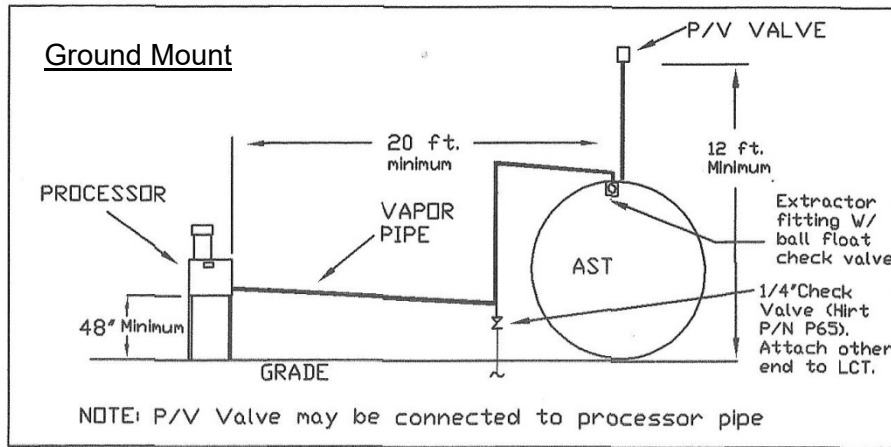

**Figure 1A-4**  
**Example Layout of a Liquid Condensate Trap Installed in an AST System**

